

SAP Conventions version 9.0

Applicable to SAP 2012 (v 8.2) and SAP 10 (v 10.2) from 01 December 2022

Conventions apply to SAP 10 (England) and SAP 2012 (Scotland and Wales until future notice). These are clearly marked throughout the document.

Conventions applied for design stage calculations submitted to building control may be carried through to the as-built stage.

This edition of the Conventions supersedes all previous editions and, where any Convention is in conflict with the published SAP specification, the Convention takes precedence.

A SAP EPC is issued for new dwellings at the stage of completion as required by the Energy Performance of Buildings Regulations. Otherwise, an EPC for an existing dwelling is issued (using either SAP or RdSAP software), subject to client wishes and the availability of data.

Assessors should be familiar with relevant version of the SAP specification including its Appendices and Tables, as these conventions do not aim to duplicate the conventions therein but rather to provide further guidance and clarification.

New and amended conventions, applicable to SAP10 indicated by shaded background.

The list of conventions will be extended as appropriate.

Note:

In Northern Ireland TB F1 2006, TB F1 2012, TB F1 2012 with 2014 amendments and TB F1 2022 refer to SAP 2009. SAP 2012 and SAP10 Conventions do not apply in NI; refer to SAP 2009 Conventions version 5.0 downloadable from [RdSAP Conventions \(bre.co.uk\)](https://www.bre.co.uk/RdSAP-Conventions)

#	Limitations	Topic	Conventions	Issue date
GENERAL				
1.01	SAP 2012 and SAP 10	Default values	<p>SAP provides default values for many items, such as window U-values and boiler efficiency.</p> <p>Whenever specific product information is available, that shall be used rather than default values.</p> <p>However, when using any specific values there needs to be documentary evidence to support them.</p> <p>For items using the database, the evidence required is that the specific named product, e.g. boiler, is the one being installed.</p>	<p>Sept 2010</p> <p>Amended Dec 2022</p>
1.02	England SAP10	Pressure test (as-built assessment)	<p>An air pressure test should now be carried out on every dwelling.</p> <p>SAP Assessor should receive pressure test result from the Builder.</p>	<p>Sept 2010</p> <p>amended March 2011</p>
	Wales SAP2012		<p>The as-built assessment cannot be processed unless:</p> <p>(a) information is provided that meets the evidence requirements of A2.4 or</p> <p>(b) in England the alternate conditions of AD L1A 2013 and AD L1A 2013 with 2016 amendments (both for use in England) paragraph 3.22 or AD L1A 2010 (for use in E&W) paragraph 5.23, apply, or</p> <p>(c) in Wales the alternate conditions of AD L1A 2014 and AD L1A 2014 with 2016 amendments (both for use in Wales) paragraph 6.4.10 or AD L1A 2010 (for use in E&W) paragraph 5.23 apply, or</p> <p>(d) evidence of a specific dispensation issued in writing by Building Control.</p>	<p>amended October 2015</p> <p>amended May 2016</p> <p>amended Aug 2017</p> <p>amended Dec 2022</p>

#	Limitations	Topic	Conventions	Issue date
1.02(a)	<p>Scotland</p> <p>SAP 2012</p>	<p>Pressure test (EPC, as-built assessment)</p>	<p>The EPC assessment cannot be processed unless:</p> <p>(a) for a dwelling that was tested, the measured infiltration rate for the dwelling is used in the calculation. This should be the test result for that dwelling, recorded on a certificate issued by a person who has demonstrated competence in air tightness testing to the satisfaction of the Verifier*; or</p> <p>(b) for a dwelling that was not tested, the declared (or agreed) infiltration rate accepted by the Verifier is used in the calculation. This should be confirmed to the assessor by the developer following both sample testing of other dwellings on the development and any remedial action agreed with the verifier as a result of those tests.</p> <p>* Verifiers are the organisations, appointed by Scottish Ministers, who check and approve Building Warrant Applications. Each of Scottish Local Authorities is the verifier for their geographical area.</p>	<p>Aug 2017</p> <p>Amended Dec 2022</p>

#	Limitations	Topic	Conventions	Issue date
1.03	<p data-bbox="331 164 432 193">England</p> <p data-bbox="331 212 427 240">SAP 10</p>	<p data-bbox="521 164 674 193">BREL report</p> <p data-bbox="521 212 768 240">See also Appendix 7</p>	<p data-bbox="795 164 1648 193">BREL report is produced by SAP Assessor from SAP 10.2 software.</p> <p data-bbox="795 212 1827 272">All approved SAP 10.2 software produce the BREL report for the building as a standard output option.</p> <p data-bbox="795 292 1776 320">Two versions of the BREL report should be produced, using the approved software.</p> <ol data-bbox="842 339 1742 368" style="list-style-type: none"> a. The first, the design stage BREL report is generated before works begin. <p data-bbox="889 387 1715 477">A supporting list of the documentary evidences listed in Appendix 1 – Documentary evidence and specifications is required to complete SAP assessment and generate BREL report (as designed).</p> <ol data-bbox="842 496 1827 585" style="list-style-type: none"> b. The second, the as-built BREL report, is issued when the dwelling is completed. A supporting list of specifications and any changes to the list of specifications that was provided at design stage is required to complete SAP Assessment. <p data-bbox="889 604 1809 694">The as-built BREL report should be signed by the person carrying out the SAP assessment to confirm that the as-built calculations are accurate and that the supporting documentary evidence and photographs have been reviewed.</p> <p data-bbox="889 713 1827 802">The as-built BREL report should be also signed by the developer to confirm that the dwelling has been constructed or completed according to the specifications in the report.</p> <p data-bbox="889 821 1821 911">APPENDIX 7 Examples of details submitted as photographic evidences” of this document provides indication on which details need to be photographed. See Appendix 7 for details.</p> <p data-bbox="889 930 1827 1051">Photographs should be digital and of sufficient quality and high enough resolution to allow a qualitative audit of the subject detail. Close-up photographs may be needed where a long shot image provides insufficient detail. More than one image of each detail may be needed.</p> <p data-bbox="889 1070 1805 1131">Geo-location should be enabled to confirm the location, date and time of each image.</p> <p data-bbox="889 1150 1821 1294">Each image file name should include a plot number and detail reference according to the numbers used in paragraph B7 of AD L1 (2021). For example, Plot 1 eaves detail would be P1/3b. Refer to Appendix B in: Approved Document L, Conservation of fuel and power, Volume 1: Dwellings (publishing.service.gov.uk) for more details if required.</p> <p data-bbox="889 1313 1697 1342">Builder may provide a document with the description of photographs.</p>	<p data-bbox="1865 164 1989 193">Sept 2010</p> <p data-bbox="1865 212 2058 272">amended March 2011</p> <p data-bbox="1865 292 2047 352">amended Aug 2017</p> <p data-bbox="1865 371 1977 432">amended Dec 2022</p>

#	Limitations	Topic	Conventions	Issue date
1.03 (cont.)	Wales SAP 2012	Regulations compliance report	<p>As a minimum, building control should be provided with:</p> <ul style="list-style-type: none"> - the regulations compliance report, and - listing of the input data <p>Building Control should also be supplied with any supporting information that they may request. The compliance report may show a fail under some headings; in these circumstances it is the decision of building control as to whether or not they approve the construction.</p> <p>Any differences between the as-designed specification and the as-built specification should be highlighted on the input data list.</p>	amended Dec 2022
1.03(a)	Scotland SAP 2012	Regulations compliance report	<p>Whilst not mandatory, production of a Regulations Compliance Report generated by the SAP software is good practice.</p> <p>Compliance with Section 6 Energy standards 6.1 to 6.6 is demonstrated at design stage, prior to issue of a building warrant.</p> <p>Where changes in design or specification during construction changes any element of the original SAP data input, the Verifier should be notified and be provided with updated information to demonstrate that compliance is maintained.</p> <p>* see convention 1.02(a) for the definition of a Verifier</p>	Aug 2017 amended Dec 2022
1.04	England SAP 10	When to issue an Energy Performance Certificate (EPC)	<p>EPC is produced once the dwelling is physically complete.</p> <p>Also BREL Report must be signed by both developer and SAP Assessor before EPC can be issued.</p> <p>Refer to: A guide to energy performance certificates for the marketing, sale and let of dwellings (publishing.service.gov.uk) for more information.</p>	Sept 2010 amended March 2011 amended Aug 2017 amended Dec 2022


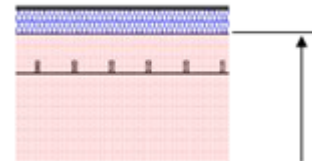
#	Limitations	Topic	Conventions	Issue date
1.04 (cont.)	Wales SAP 2012	When to issue an Energy Performance Certificate (EPC)	<p>EPC is produced once the dwelling is physically complete. A dwelling is deemed 'physically complete' when all the following conditions are met:</p> <ul style="list-style-type: none"> a) Commissioning of the heating system has been satisfactorily completed, and b) Thermal bridging details are signed off, and c) Air permeability is confirmed via pressure testing of representative dwellings, and d) The dwelling itself is complete and could be pressure tested. <p>The developer should feed information about changes from the design stage to the as-built stage to the OCDEA so that an EPC can be produced. Assessors should not produce an EPC without such information, and it may be necessary to prompt the developer to produce the required information.</p> <p>A copy of the EPC should be provided to the client (in electronic or paper form) to be pass to the building control body.</p>	amended Dec 2022
1.04 (a)	Scotland SAP 2012	Production of an on-construction EPC	<p>An EPC must reflect any variations or additional information, such as pressure test results, arising during the construction of a new dwelling.</p> <p>Work to produce an EPC for a new dwelling, including access to Scottish EPC Register (SEPCR) systems, should not commence until the Assessor receives confirmation that all construction work and testing that could affect the assessment process is complete and the Assessor has established that they are in possession of all information needed to undertake assessment.</p>	Aug 2017 amended Dec 2022
1.05	England SAP10	SAP version for EPCs (see also 1.10)	<p>SAP 10 is required for compliance from June 15th 2022, any buildings that submitted for compliance on or after June 15th will need the EPC to be generated using SAP 10.</p> <p>SAP 2012 EPCs may be lodged for buildings for which compliance was granted before 15th June 2022.</p>	Dec 2022

#	Limitations	Topic	Conventions	Issue date
1.05	Wales and Scotland SAP2012	SAP version for EPCs (see also 1.10)	<p>EPCs are normally produced using the latest SAP version. If the dwelling concerned was assessed for building regulation compliance using an earlier SAP version the data is transferred to SAP calculator that uses the current SAP version for EPC production.</p> <p>In unusual cases where the dwelling has been occupied since completion but before the EPC is issued, a SAP EPC is appropriate if it is established that the dwelling has not been meaningfully altered since completion or if the details of any alteration are known and can be incorporated in the assessment. Otherwise, it should be treated as an existing dwelling and assessed via RdSAP.</p> <p>In Scotland, in support of the completion certificate submitted to the Verifier*, a SAP EPC must be provided for each new dwelling which is subject to standard 6.9. An RdSAP EPC cannot be used for this purpose. Any certification using RdSAP may only occur as a separate action, after acceptance of a completion certificate for the dwelling by the Verifier.</p> <p>* see convention 1.02(a) for the definition of a Verifier</p>	<p>Sept 2010 amended Sept 2012 added Aug 2017 amended Dec 2022</p>
1.07	Wales SAP2012	Design water use	<p>For new build in England & Wales it is now required that the dwelling is designed to use not more than 125 litres/person/day for compliance with E&W Part G.</p> <p>SAP assessors may assume that building control will establish compliance with E&W Part G and tick the applicable box in SAP software for new dwellings in England & Wales.</p> <p>In other countries, and for any existing dwelling, this option does not apply.</p>	<p>Sept 2010 amended March 2011 amended Dec 2022</p>
1.08		Flats v. houses	<p>A house or bungalow has both a heat loss ground floor and an exposed roof. A dwelling without a heat loss floor cannot be a house and must be treated as a flat or maisonette. Generally, a flat or maisonette does not have both a heat loss ground floor and a heat loss roof (although there are some exceptions such as a ground floor flat with an extension or when the footprint of a flatted development is 'stepped').</p>	<p>Sept 2011 amended Sept 2012</p>
1.09		Database version	<p>SAP calculations must always be done using the latest version of the database (PCDB), at both as-designed and as-built stages.</p>	<p>Sept 2011</p>

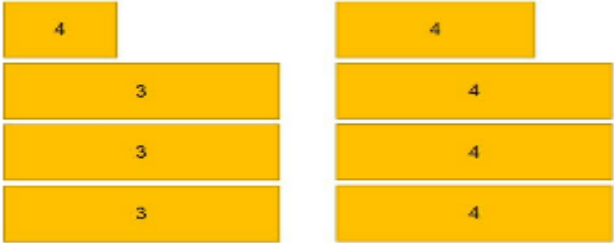
#	Limitations	Topic	Conventions	Issue date
1.10	Not Scotland	Software version (see also 1.05)	SAP calculations must always be done using the latest version of approved SAP software at both as-designed and as-built stages. The only exception is where the as-designed calculation was done using an earlier software version and building control allows the use of that version for the as-built calculation.	Sept 2011 amended Dec 2022
1.11	Scotland only SAP 2012	Software version	New build SAP calculations produced in support of standard 6.1 (carbon dioxide emissions) should be carried out using the version of SAP current at the date the building warrant application is lodged. This as-designed calculation may continue to use the same version of the software for the duration of the warrant process, including any amendment to the original warrant. Where a newer version of SAP is available, use of this in respect of standard 6.1 is at the discretion of the applicant. For the issue of an EPC on completion of the dwelling, the version of SAP current at the date of completion must be used (see convention 1.05).	Sept 2011 amended Dec 2022
1.12		Sheltered sides	Enter actual number if known, otherwise 0 (i.e. the worst case). In Scotland, not more than 2, and 2 if unknown.	October 2015

#	Limitations	Topic	Conventions	Issue date
1.13a	England SAP10	Conservatory	<p>For a conservatory or porch installed as part of the construction of a new dwelling, the treatment of the conservatory or porch depends on whether both of the following have been achieved.</p> <p>a. There is adequate thermal separation between the dwelling and the conservatory or porch.</p> <p>b. The dwelling's heating system is not extended into the conservatory or porch (i.e. unheated)</p> <p>If both (a) and (b) have been achieved, the conservatory or porch should be treated as if it were an extension being added onto an existing dwelling. The guidance for new elements in existing dwellings in Section 10 should be followed.</p> <p>If either or both of (a) or (b) has not been achieved, the conservatory or porch should be treated as a room in the new dwelling. The guidance for the whole new dwelling should be followed, including for dwelling primary energy rate, dwelling emission rate and dwelling fabric energy efficiency rate calculations</p>	October 2015 amended Dec 2022
	Wales SAP 2012	Heated conservatory	<p>Included in calculations if:</p> <ul style="list-style-type: none"> - not thermally separated from main dwelling, or - heated by dwelling's main heating system (England) or heated by fixed heaters (Wales) 	
1.13b	Scotland SAP 2012	Heated conservatory	Included in DER/TER calculations if not thermally separated from main dwelling.	October 2015 amended Dec 2022
1.13c	Northern Ireland SAP 2009	Heated conservatory	<p>Included in calculations if:</p> <ul style="list-style-type: none"> - not thermally separated from main dwelling, or - independent temperature and on/off controls are not provided to the conservatory 	October 2015 amended Dec 2022

#	Limitations	Topic	Conventions	Issue date
1.14 (new)		Terrain Type	<p>Terrain type should be based on the abundance of obstacles in the curtilage of the dwelling, not necessarily the characteristics of the surrounding area.</p> <p>For example, a site containing a number of dwellings, but located away from a village/town should be classed as suburban as the number of dwellings would likely make the use of a wind turbine unviable.</p>	Dec 2022
DIMENSIONS				
2.01		Average storey height see Appendix 4. Dwelling dimensions	Where there are rooms extending into the roof space, the average storey height is needed for the volume calculation (see 2.03). This is the average height of the habitable area (plus the thickness of the intermediate floor if it is an upper storey of the dwelling).	Sept 2010 amended Dec 2022
2.02		Storey height of flats over garages see Appendix 4. Dwelling dimensions	In the case of a flat over an unheated garage (or similar) where the entrance to the flat is on the ground floor with a heated stairway leading to the main part of the flat, an exception is made to the rule in 2.01: <ol style="list-style-type: none"> a) The intermediate floor thickness is added to the ground floor height b) The height of a first floor is measured from internal floor to ceiling 	Sept 2010 amended Dec 2022

#	Limitations	Topic	Conventions	Issue date
2.03		Dwelling volume	<p>The volume of the dwelling comprises the internal volume of the dwelling, measured between the finished internal surfaces of the elements bounding the dwelling. Spaces outside the dwelling, for example roof voids, are not included even though within the insulated fabric.</p> <p>A roof/ceiling void is not included in the dwelling volume but included into wall area; this dimension should be for calculating the volume:</p>  <p>This dimension should be used for calculating wall area:</p> 	Sept 2011 amended Aug 2017
2.04		Gable wall area	<p>Where the roof insulation is between the ceiling joists, the area of the gable wall above the finished ceiling level does not need to be included in the heat loss wall area.</p> <p>Where the insulation is along the slope of the roof (between the rafters) the gable wall needs to be included in the heat loss wall area (unless it is a mid-terrace house).</p> <p>Note that the gable wall area also needs to be included where there is a flat ceiling, however with insulation in the slope between the rafters.</p>	Sept 2011
2.05		Internal elements (for thermal mass calculation)	<p>Areas of internal and party walls, floors and ceilings are measured:</p> <ul style="list-style-type: none"> - vertically using floor-to-ceiling height - horizontally as the length on plan ignoring any intersecting partitions. - disregarding openings <p>Appendix 5. Thermal mass parameters provides the thermal mass for some illustrative constructions.</p>	Sept 2011 amended Aug 2017 amended Dec 2022

#	Limitations	Topic	Conventions	Issue date
2.06		Bay windows	<p>Include the area of the bay in the floor area. Include the perimeter of the bay in the total perimeter for calculation of thermal bridging wall/floor and wall/roof.</p> <p>See also convention 5.16.</p>	amended Sept 2016
2.07		U-values of elements of room in roof insulated at rafters	<p>Where the roof insulation follows the shape of the room, the U-value of the walls and ceilings to the unheated roof voids should be calculated as normal with the room-in-roof shelter factor applied.</p> <p>Where the insulation is contained entirely within the rafters, the U-value of the sloping ceilings should be multiplied by a factor of 0.72, and the resultant U-value used for the walls and ceilings to the unheated voids spaces.</p> <p>See diagram 3.1 in Appendix 3 Appendix 3 Converted U-values for room in roof .</p>	Aug 2017

#	Limitations	Topic	Conventions	Issue date
2.08		Number of storeys in the block	<p>Enter the number of storeys directly above and below (also including the storey the flat is in) each individual flat.</p> <p>If floor area of top floor(s) differs from the floor area of the flats below, enter the total number of storeys directly above or below including those storeys of the dwelling, which extend across the greater proportion of the dwelling footprint.</p>  <p>Number of storeys in the block = 3 for the assessments of ground, first and second floor flats If assessment is for the top flat which is less than 50% of floors below, the total number of of storeys = 4, because it is included in the count</p> <p>Number of storeys In the block = 4</p>	Dec 2022

#	Limitations	Topic	Conventions	Issue date
OPENINGS				
3.01		U values of doors to unheated spaces	<p>It is generally not necessary to adjust the U-values of doors in semi-exposed walls, in particular when the area of the element covered by the unheated space is less than 10% of the total exposed area of all external walls.</p> <p>In some cases (such as a flat with very small external elements) the door may be more than 10%, in which case the U-value of the door in the semi-exposed wall should be adjusted in the same way as that for a semi-exposed wall (SAP documentation section 3.3).</p> <p>Note: Attached garages are disregarded altogether.</p>	Sept 2010 corrected Aug 2017
3.02		Window areas	<p>To be specified either individually or at least per elevation.</p> <p>Window area is the area of opening in the wall.</p>	Sept 2011 amended Dec 2022
3.03		External doors	<p>Solid door: if glazed area < 30% of door area</p> <p>Semi-glazed door: if glazed area 30-60% of door area</p> <p>Glazed door with glazed area > 60% of door area, included as a window</p>	October 2015
3.04	England SAP10 Wales SAP2012	Window orientation	The actual orientation of all windows must be specified at as built stage.	October 2015 amended Aug 2017 amended Dec 2022
3.04(a)	Scotland SAP 2012	Window orientation	<p>For a design-stage SAP calculation in support of standard 6.1, guidance permits the designer to either specify the orientation of all glazing or assume that all glazing is oriented east/west (see Section 6 Energy, clause 6.1.3 of the Domestic Technical Handbook).</p> <p>For EPC production, the orientation of all windows must be specified for the calculation to be representative of the actual dwelling.</p>	Aug 2017

#	Limitations	Topic	Conventions	Issue date
3.05		Sun tunnels	<p>If a manufacturer's declared U-values are available, use the diffuser U-value and calculate the weighted-average roof U-value.</p> <p>If the U-value of a diffuser is not available from the manufacturer, use the U-value as for windows from SAP Table 6e.</p>	March 2021
VENTILATION				
4.01		Mixed centralised and decentralised mechanical ventilation	<p>Where there is a mixed mechanical system, e.g. consisting of two centralised MEV systems or a centralised MEV system serving part of the dwelling and decentralised MEV serving the remainder, the data for the two systems are combined and the result entered into SAP software. A spreadsheet to assist the process is available from BRE website www.bre.co.uk/SAP2012</p> <p>In the case of MVHR with integral electric duct heating, the duct heating should be treated as direct electric heating, and MVHR is specified as normal.</p> <p>Specify electric heating as secondary if a dwelling has any form of main heating or has primary heating by an electric room heater if there is no other form of heating in the dwelling.</p>	<p>Sept 2010</p> <p>amended March 2021</p>
4.01a		Mixture of MVHR and intermittent fans	<p>Where there is a mixed system, e.g. consisting of MEV systems and intermittent fans, the data are combined and the combined Specific Fan Power is entered into SAP software.</p> <p>A spreadsheet to assist the process is available from www.bre.co.uk/SAP2012</p>	Dec 2022
4.02		Mechanical ventilation but no data for the number of wet rooms	If there is mechanical ventilation but no data for the number of wet rooms served, use the default data (SAP Table 4g).	Sept 2010
4.03		Solar powered ventilation	Solar powered vents should be entered into SAP software as passive vents.	Sept 2010

#	Limitations	Topic	Conventions	Issue date
4.04		Wet rooms	<p>The data for mechanical ventilation systems is given according to the number of wet rooms. A wet room is a room used for domestic activities (such as cooking, clothes washing and bathing) which give rise to significant production of airborne moisture, e.g. a kitchen, utility room, bathroom, shower room and also sanitary accommodation.</p> <p>For SAP the number of wet rooms to be entered is the additional wet rooms in addition to the kitchen, which is assumed always to be present.</p>	Sept 2011
4.05		Semi-rigid ducts	Semi-rigid ducts can be specified only if found in the database (brand and model)	October 2015
4.06		Individual ventilators with heat recovery	<p>If a single individual ventilator with heat recovery – disregard;</p> <p>if individual intermittent ventilators with heat recovery installed in each wet room, treat as natural ventilation with intermittent extract fans;</p> <p>if continuously running – treat as default Decentralised Extract Ventilation; in this case the heat recovery element is disregarded.</p>	Aug 2017
4.07		Positive Input Ventilators from Loft	In the case of PIV supplying preheated air from the loft – specify the actual number of extract fans, with a minimum of 2 extract fans required.	Aug 2017

#	Limitations	Topic	Conventions	Issue date
U-VALUES AND THERMAL BRIDGING				
5.01		Correct U-value calculations	<p>U-values are calculated using the conventions given in BR 443.</p> <p>See also Appendix 3 Converted U-values for room in roof .</p> <p>SAP assessors should establish the specification of the construction for each element and should satisfy themselves that the U-values used in the calculation are correct.</p> <p><u>Acceptable routes are:</u></p> <ul style="list-style-type: none"> - calculation provided by a person that is a member of a recognised U-value calculation competency scheme, or, - calculation provided by an OCDEA, level 4 NDEA or any other process recognised by Accreditation Schemes/Approved Organisation and Government, or, - calculation provided by another party and checked by the assessor <p>In some cases, the calculation may depend on other pre-calculated results; in those cases the sources of the data used must be available. For example, a suspended floor where the thermal resistance of the floor deck has been calculated by numerical modelling.</p>	<p>Sept 2010</p> <p>amended March 2011</p> <p>amended October 2015</p> <p>amended Aug 2017</p> <p>amended March 2021</p>
5.00		Approach to MMC and off-site	Treat U-values and Psi-values the same way as for any other built form	Dec 2022
5.02		Swimming pools within a dwelling	<p>In England U-values of swimming pool basins need to be checked for building control applications from 01 October 2010.</p> <p>In Wales U-values of swimming pool basins need to be checked for building control applications from 01 October 2010 (ADL-1A for use in England and Wales) and from July 2014 (ADL-1A for use in Wales).</p> <p>In Scotland, there is no separate maximum U-value for the insulation envelope specific to swimming pool basins.</p> <p>However, in all countries, for entry into the SAP calculator the U-value of the floor is to be obtained as if the swimming pool basin were not there, although the pool hall should be included. The area covered by the pool should be replaced with the equivalent area of floor with the same U-value as the pool surround.</p>	<p>Sept 2010</p> <p>amended March 2011</p> <p>amended Aug 2017</p>

#	Limitations	Topic	Conventions	Issue date
5.03		Party wall U-values	<p>In the context of U-values, 'party wall' includes any wall between the dwelling and another heated space which can be:</p> <ul style="list-style-type: none"> - another dwelling - commercial premises - a heated corridor or stairwell in a block of flats - a heated common area <p>Note. A heated corridor is one with controlled fixed heaters. Heat from distribution pipes is to be disregarded.</p> <p>The only U-values at present for party walls are 0, 0.2 and 0.5. This applies to both flats and houses regardless of construction type (masonry, timber frame etc).</p> <p>U = 0.5 should be used for party walls unless documentary evidence is provided, in which case:</p> <p>A solid party wall has U = 0.</p> <p>To qualify for U = 0.2 (effective edge sealing):</p> <ul style="list-style-type: none"> - the sealing must prevent air going in or out of any cavity - the sealing is required top and bottom and vertically. <p>To qualify for U = 0:</p> <ul style="list-style-type: none"> - any cavity must be sealed as above, and - any cavity must be fully filled <p>Framed systems (timber or metal) may have more than one cavity.</p>	<p>Sept 2010</p> <p>amended March 2011</p> <p>amended October 2015</p>

5.04		Windows and roof windows – U-values and g-values	<p>The U-value is that of the complete window, not that of the glazing alone.</p> <p>It is acceptable to use an average U-value, as long as the average U-value used is based upon a standard Glass and Glazing Federation (GGF) 1230 x 1480 mm test window in accordance with BS EN ISO 10077-1. The GGF window is a two-pane window with one open and one fixed pane. However, it is preferable to assign a specific U-value to individual windows (which manufacturers can usually provide). If the design has large areas of glazing a better DER usually results by using individual window U-values (and individual frame factors for solar gain).</p> <p>In the case of a BFRC (or other approved certification body for fenestration products) rated window, the U-value and g-value are taken from the front of the certificate or from the simulation report produced by the BFRC certified simulator. The g-value is that for the window as a whole, incorporating the frame factor. Because of this, the frame factor is set to 1 in the SAP calculation.</p> <p>The g-values for BFRC windows are usually less than 0.5 and should be checked if greater.</p> <p>In the case of manufacturer-declared properties of windows the data needed as U-value, g-value for the glazing and frame factor. Documentary evidence of these data is required.</p> <p>Use the same source of u-value and g-value if possible, where g-value is not available use default g-value.</p> <p>Two types of g-value can be available – $g_{(glazing)}$ and $g_{(window)}$ if data is from BFRC.</p> <p>If $g_{(window)}$ is used from BFRC, set frame factor as 1.</p> <p>For windows and roof windows in plane with the walls or sloping roofs that are NOT vertical BR 443 gives U-value adjustment which can be applied to windows and roof windows depending on the inclination.</p> <table border="1" data-bbox="792 1011 1659 1238"> <thead> <tr> <th rowspan="2">Inclination of roof</th> <th colspan="2">U-value adjustment (W/m2K)</th> </tr> <tr> <th>Double glazed</th> <th>Triple glazed</th> </tr> </thead> <tbody> <tr> <td>70° or more (treat as vertical)</td> <td>0.0</td> <td>0.0</td> </tr> <tr> <td><70° and >60°</td> <td>+0.2</td> <td>+0.1</td> </tr> <tr> <td>≤70° and >40°</td> <td>+0.3</td> <td>+0.2</td> </tr> <tr> <td>≤40° and >20°</td> <td>+0.4</td> <td>+0.3</td> </tr> <tr> <td>≤20° (treat as horizontal)</td> <td>+0.5</td> <td>+0.4</td> </tr> </tbody> </table> <p>For out of plane roof lights (on upstands or building kerbs) tested or modelled at horizontal position, no adjustment needed.</p>	Inclination of roof	U-value adjustment (W/m2K)		Double glazed	Triple glazed	70° or more (treat as vertical)	0.0	0.0	<70° and >60°	+0.2	+0.1	≤70° and >40°	+0.3	+0.2	≤40° and >20°	+0.4	+0.3	≤20° (treat as horizontal)	+0.5	+0.4	<p>Sept 2010</p> <p>amended Sept 2012</p> <p>amended Aug 2017</p> <p>amended Sept 2018</p> <p>amended March 2021</p> <p>Amended May 2022</p> <p>Amended Dec 2022</p>
Inclination of roof	U-value adjustment (W/m2K)																							
	Double glazed	Triple glazed																						
70° or more (treat as vertical)	0.0	0.0																						
<70° and >60°	+0.2	+0.1																						
≤70° and >40°	+0.3	+0.2																						
≤40° and >20°	+0.4	+0.3																						
≤20° (treat as horizontal)	+0.5	+0.4																						

#	Limitations	Topic	Conventions	Issue date
5.06	England(SAP 10)	Thermal bridging	<p>Thermal bridges should be assessed in a new dwelling using one of the following methods:</p> <ul style="list-style-type: none"> a. Use construction joint details calculated by a suitably competent person following the guidance in the Building Research Establishment's BR 497 and the temperature factors set out in the Building Research Establishment's Information Paper 1/06. b. Use junction details from a reputable non-government database containing independently assessed thermal junction details, such as Local Authority Building Control's Construction Details library. c. Use the values in the Standard Assessment Procedure, Table K1. A mixture of known and default values may be used. d. Use a default ψ-value of 0.20 W/m²K. <p>NOTE: A mix of approaches may be used for different elements on the same dwelling. When using the approach in (a) or (b) above, an appropriate system of site inspection should be in place.</p>	Added Dec 2022

#	Limitations	Topic	Conventions	Issue date
	Scotland SAP 2012	Thermal bridging	<p>The transmission heat transfer coefficient associated with non-repeating thermal bridges H_{TB} must be calculated, or the calculation verified, by the SAP assessor; a γ value can only be used if it is:</p> <ul style="list-style-type: none"> (a) the default value of $\gamma=0.15^*$ (b) derived from H_{TB} calculated following the rules in SAP 2012 Appendix K, or (c) calculated for another dwelling that is identical except for orientation. <p>When calculating thermal bridge junctions at <u>either design or as-built stage</u>:</p> <p>All junction types listed in SAP Table K1 and in these conventions should be considered. Evidence is required for Ψ-values other than the defaults in SAP Table K1. Junction types that are neither listed in SAP Table K1 nor in these conventions are disregarded.</p> <p><u>At the design stage:</u></p> <p>For a junction to be assigned a Ψ-value for an Accredited Construction Detail (ACD) or an Enhanced Construction Detail (ECD) (see web links at the end of these conventions) for the purposes of SAP calculations, a list of the intended junction detail reference numbers should be confirmed by the client. The thermal bridging should be specified using (a)*, (b) or (c) above.</p> <p><u>At the as-built stage:</u></p> <p>For a junction to be assigned a Ψ-value for an Accredited Construction Detail (ACD) or an Enhanced Construction Detail (ECD) for the purposes of SAP calculations, confirmation is needed from the builder that the specific junction has been built in accordance with Accredited Construction Details and that the associated checklists have been completed. A list of the junction detail reference numbers should be confirmed by the client. The values for the design stage are used provided that (a) they were fully specified at the design stage and (b) it is confirmed that no design alterations were made.</p> <p>* Note: $\gamma=0.15$ is subject to revision; use the value applicable in the current Building Regulations. In Scotland, a default value of $\gamma=0.15$ cannot be assigned in a SAP calculation or EPC relating to a building warrant applied for on or after 1 October 2015. Calculation of H_{tb} must be undertaken.</p>	<p>Sept 2010</p> <p>re-written March 2011</p> <p>amended Aug 2017</p> <p>amended March 2021</p> <p>amended Dec 2022</p>

#	Limitations	Topic	Conventions	Issue date
5.07	<p>Wales</p> <p>SAP 2012</p>	<p>Thermal bridging, sources of Ψ-values (Appendix 2)</p>	<p>The Ψ-value for each junction is obtained as follows:</p> <ol style="list-style-type: none"> 1. For any junction for which an ACD is being used use the applicable Ψ-value in the 'accredited' column in Table K1*, or 2. For any junction for which an ECD is being used use the Ψ-value associated with the junction reference number, or 3. For any junction for which a calculated Ψ-value is provided, this may be used subject to written confirmation that the calculation was performed by someone with suitable experience and expertise defined in AD L1A paragraph 3.10, or 4. If none of the above applies for any junction, use the Ψ-value for the applicable junction type from the 'default' column in Table K1*. <p>Values for accredited details can be used only for those junctions with an ACD/ECD reference number, e.g. for junction E2 an example is "MCI-WD-02" or Scottish ACD "1.08".</p> <p>See Appendix 2.1 Thermal bridges for locations of the various junction types.</p> <p>If a Ψ-value for any junction is not available, use the applicable default value from SAP Table K1 (see 5.08 for exceptions). The following junctions in Table K1 have no ACDs associated with them and so no ACD reference number: E8, E9, E16, E17, E19, E20, E21, E22, E23, E24, E25, P1, P6, P7, P8, R1 to R9. If no calculated value is available use the default Ψ-value.</p> <p>When there is more than one junction of a given junction type which have different Ψ-values (e.g. corners in the main dwelling and stud wall corner in a roof room; multiple types of lintel), either:</p> <ol style="list-style-type: none"> (a) enter the junction type more than once with its respective Ψ-values and lengths, or (b) use the highest Ψ-value for the junction type with the total length of the junctions, or (c) calculate a weighted average (Ψ-value for each junction type weighted by the length of each junction) and enter the result into the SAP calculator along with the total length of the junctions. <p>* Note: "Accredited" column in Table K1 cannot be used in Scotland.</p>	<p>March 2011</p> <p>amended Sept 2012</p> <p>amended October 2015</p> <p>amended Aug 2017</p> <p>amended Dec 2022</p>

#	Limitations	Topic	Conventions	Issue date
5.08	Wales SAP 2012	Thermal bridging, additional junction types	<p>The following values may also be used as accredited values:</p> <p>E14: $\Psi = 0.04 \text{ W/m}\cdot\text{K}$ E15: $\Psi = 0.28 \text{ W/m}\cdot\text{K}$ P4: $\Psi = 0.12 \text{ W/m}\cdot\text{K}$ (applied to each dwelling) P5: $\Psi = 0.04 \text{ W/m}\cdot\text{K}$ (applied to each dwelling)</p> <p>For P2 and P3 the default value is 0.0 and these junctions need not be considered.</p> <p>For E16 (corner) it is acceptable to use the value of 0.09 W/m·K from the “Accredited” column in SAP Table K1* provided that the construction around the corner is the same as the rest of the wall and is not interrupted by any structural elements.</p> <p>The value of $\Psi = -0.09 \text{ W/m}\cdot\text{K}$ for the inverted corner E17 may be used only in conjunction with the value $\Psi = 0.09 \text{ W/m}\cdot\text{K}$ for a normal corner E16.</p> <p>* Note: “Accredited” column in Table K1 cannot be used in Scotland</p>	<p>March 2011</p> <p>re-written October 2015</p> <p>amended Aug 2017</p> <p>amended Dec 2022</p>
5.10		Thermal bridging around openings	In the case of a lintel (and other window or door surrounds) the length of junction is the length of the opening in the wall.	Sept 2011
5.11		Thermal bridges shared by more than one dwelling	<p>Divide the total Ψ-value by the number of dwellings involved, and apply that to each dwelling. Thus for a junction between two dwellings use $\Psi/2$, between three dwellings use $\Psi/3$.</p> <p>Note. In SAP Table K1 the Ψ-values for junctions E7, E9, E18, E25 and P1 to P8 inclusive are already divided by 2. If using values from Table K1 for any of these junctions:</p> <ul style="list-style-type: none"> - if between two dwellings use the value given in Table K1; - if between three dwellings use the value from Table K1 multiplied by 2/3. <p>See also Appendix 2.1 Thermal bridges.</p>	October 2015
5.12		Thermal bridges to unheated spaces	<ol style="list-style-type: none"> 1. Obtain the Ψ-value as normal (between inside and outside) 2. Multiply psi-value by the factor from Appendix 2.3: Factors for sheltered thermal bridges 	<p>October 2015</p> <p>amended Aug 2017</p>
5.13		Thermal bridging	<p>Lengths of all junctions must be entered into the software to allow calculation of TER, except when the default value of $y = 0.15$ (SAP 2012) or $y=0.20$ (SAP 10.2) is used.</p> <p>For curtain walls see also convention 5.18 and Appendix A2.5</p>	<p>October 2015</p> <p>Amended Dec 2022</p>

#	Limitations	Topic	Conventions	Issue date
5.14		Thermal bridging – door sills	Include the lengths of sills of doors, including any doors treated as windows, in the length of the wall/floor junction for the floor level that contains the doors.	June 2015
Cont.	England SAP 10	Thermal mass	<p>Calculated according to Table 1e in SAP 10.2 specification.</p> <p>The Thermal Mass Parameter (TMP) is required for calculations by SAP 2012. It can be:</p> <p>a. calculated from the areas and kappa values of each element, including party walls, party floors and party ceilings and both sides of internal partitions (which include internal walls and intermediate floors), where the kappa values are from SAP Table 1e or calculated following the guidelines in SAP Table 1e, or</p> <p>b. entered into software as a TMP value that has been calculated as in a. (for example using a spreadsheet).</p> <p>For indicative heat capacity value (κ-value) see Table 1e in SAP 10.2 specification.</p> <p>Note:</p> <p>Appendix 5. Thermal mass parameters for whole dwelling is not applicable to SAP 10.</p>	<p>Sept 2010</p> <p>amended Sept 2012</p> <p>amended October 2015</p> <p>amended Aug 2017</p> <p>amended Sept 2018</p> <p>amended Dec 2022</p>
	Wales and Scotland SAP 2012	Thermal mass	<p>The Thermal Mass Parameter (TMP) is required for calculations by SAP 2012. It can be:</p> <p>a. calculated from the areas and kappa values of each element, including party walls, party floors and party ceilings and both sides of internal partitions (which include internal walls and intermediate floors), where the kappa values are from SAP Table 1e or calculated following the guidelines in SAP Table 1e, or</p> <p>b. entered into software as a TMP value that has been calculated as in a. (for example using a spreadsheet), or</p> <p>c. treated as being low, medium or high using the global values of 100, 250 or 450 kJ/m²K given in SAP Table 1f .</p> <p>For indicative thermal mass parameters, see Appendix 5. Thermal mass parameters.</p> <p>In case of a dispute, a detailed calculation via a. or b. should be undertaken.</p> <p>If the TMP is calculated, for the calculation of kappa-value of walls containing concrete, use concrete heat capacity of $C_p=840$ J/(kg·K). The source is CIBSE Guide.</p>	cont.

#	Limitations	Topic	Conventions	Issue date
5.16		Oriel windows and raised roof windows	<p>An oriel window is a form of bay window, which projects from the main wall of a building but does not reach to the ground.</p> <p>See Appendix 2.4 Thermal bridging - Convention for Oriel windows for determining Ψ-values of junctions.</p>	Aug 2017
5.17		Windows facing unheated corridor	<p>For windows facing unheated corridors use reduced U-value of window by taking into the account sheltering effect of unheated space, g-value =0 and specify over-shading factor as "heavy".</p>	amended Sept 2018
5.18		Definition of a curtain wall	<p>A curtain wall is an independent building element, which may contain translucent and opaque parts, that may extend across party walls and party floors.</p> <p>A curtain wall is an outer covering of the building; the curtain wall façade does not carry any structural load from the building, other than its own weight.</p> <p>A window or a Curtain walls consists of glazed and/or opaque panels fitted in, or connected to frames. The U-value of curtain wall façade is calculated according to EN ISO 12631 and includes thermal bridges associated with the construction of the curtain wall.</p> <p>See also convention 5.13 and Appendix 2.5 Thermal Bridging - Convention for curtain walls</p>	Sept 2018 March 2021

#	Limitations	Topic	Conventions	Issue date
5.19		Large floor-to-ceiling windows (openings) with opaque units	<p>Large floor-to-ceiling windows (which may contain translucent and opaque parts, where such windows are fitted into the external load-bearing walls) are considered as “openings” and the manufacturers would provide a U-value of the whole product and g-value of the glazed part, in such cases SAP assessors need follow the following steps:</p> <ul style="list-style-type: none"> A. Calculate the area of the opening in the wall (this equals the area of the product containing translucent and opaque sections); B. Measure the dimensions of the translucent sections (i.e. area glass) in the product and calculate the total area of glass in the product; C. Calculate the area of the opaque part by subtracting the area of glass from the total area of the product; D. Specify the area of the opaque part as a solid door, use the area calculated in step (C) and assign the U-value calculated according to BS EN ISO 10077-1 “Thermal performance of windows, doors and shutters - Calculation of thermal transmittance - Part 1”, applicable to the whole product; note that g-value or FF are not required if an element is specified as a door; E. Specify the area of glass as a window, use the area of glass calculated in step (B), assign the U-value applicable to the whole product, g-value for glass and frame factor FF=1. <p>If the product consists of several elements, add default psi-value of linear thermal bridge from SAP Table K1 between elements (use psi-value for junction E4).</p>	March 2021

#	Limitations	Topic	Conventions	Issue date
5.20		Mezzanine floors and living area measurement	<p>In the case of a mezzanine over a living area (normally it is a large built-in floor protruding from a wall with a stair access, which can be used for placing a bed or used as a study) the assessor follows the procedure:</p> <p>Living area fraction:</p> <ul style="list-style-type: none"> • Do not include the “mezzanine” floor area in the living area measurement; living area is specified as if the “mezzanine” was not present; <p>Ground floor:</p> <ul style="list-style-type: none"> • Area of the ground floor is specified as if the “mezzanine” was not present; • height of the ground floor is the area weighted average of the room height without the “mezzanine” and the height from the floor to the ceiling underside the “mezzanine” (i.e. below the “mezzanine” floor); <p>Upper floor:</p> <ul style="list-style-type: none"> • Specify floor area of the “mezzanine” as the “upper floor” area; • Height of the upper floor (above “mezzanine”) is the height from the “mezzanine” floor to the ceiling. 	March 2021
SPACE HEATING				
6.01		Micro-CHP	If the system is unavailable in the database, select condensing boiler with SAP default efficiency.	Sept 2010

#	Limitations	Topic	Conventions	Issue date
6.02		Two main heating systems	<p>Although in the large majority of cases there is only one main heating system, SAP provides for two main systems.</p> <p>A second main system is not to be confused with a secondary heater. The latter are rooms heater(s) heating individual room(s) either as a supplement to the main heating in the room (e.g. a wood burning stove in the main room) or for rooms not heated by the main system.</p> <p>A main system is generally one that would be described as central heating (a heat generator providing heat to several rooms via a heat distribution system), although the term does also include for example storage heaters and fixed direct-acting heaters in each room.</p> <p>When there are two main systems, system 1 always heats the living area.</p>	Sept 2010
6.03		Two solid fuel boilers	Where there are two solid fuel boilers feeding the same distribution system, the fraction of heat should be taken as 0.5 from each.	Sept 2010
6.04		Boiler using liquid biofuel or biogas	The boiler must be found in the Product Characteristic Data Base (PCDB) for the fuel concerned, except B30K.	Sept 2010 amended October 2015

#	Limitations	Topic	Conventions	Issue date
6.05		<p data-bbox="517 164 768 316">District heat networks (HN) and community heating systems (CH) in the PCDB</p> <p data-bbox="517 379 689 408">See also 6.15</p>	<p data-bbox="790 164 1704 225">This convention apply when connecting dwellings to a district heat network or community heating system; in SAP they are treated in the same way.</p> <p data-bbox="790 240 1809 301">Where HN or CH is included in the PCDB then all system data is provided by the data record.</p> <p data-bbox="790 320 1435 349">Provisional data records may apply for new HN or CH.</p> <p data-bbox="790 368 1827 520">HN or CH data records in the PCDB are not deleted when updated data is added; instead a new record is added with a new community network version number. If the data record is updated between the as-designed assessment and the as-built-assessment, the data record used for the as-designed assessment may be used for the as-built assessment.</p> <p data-bbox="790 539 1827 659">In the absence of HN or CH data in the PCDB, SAP assessors need to obtain details of heat generators, distribution loss, etc. from the system designers. Where a community heating (heat network is) envisaged but not yet connected, the assessment is done using the heating system installed in the dwelling at the time of assessment.</p> <p data-bbox="790 678 1585 707">See convention 6.15 for HN or CH which are not included in PCDB.</p>	<p data-bbox="1861 164 1989 193">Sept 2010</p> <p data-bbox="1861 212 2029 269">re-written October 2015</p> <p data-bbox="1861 288 2007 346">amended March 2021</p> <p data-bbox="1861 365 1980 422">amended Dec 2022</p>

#	Limitations	Topic	Conventions	Issue date
6.06		CHP supplying both dwellings and commercial buildings	<p>Where a CHP system is providing heat to dwellings and electricity to commercial premises, the electricity generation must be credited only once.</p> <p>a) If the electricity generated is included in the assessment of the commercial premises but the electricity is assumed to have the same CO₂ emission factor as electricity from the grid, the CHP heat and electrical efficiencies are entered into the SAP software. This will normally apply when the CHP is located in a different building from the commercial premises and electricity is supplied from the CHP to the commercial premises over the regional distribution network operator's (DNO) cables, and may also apply in other circumstances.</p> <p>b) If the electricity generated is included in the assessment of the commercial premises and the electricity is assumed to have a CO₂ emission factor of zero, only the CHP heat efficiency is entered into the SAP software (electrical efficiency is zero or heat-to-power ratio of 10,000).</p> <p>c) For a situation intermediate between a) and b), i.e. if the electricity generated is included in the assessment of the commercial premises and the electricity is assumed to have a CO₂ emission factor between zero and that of grid electricity, an effective CHP electrical efficiency is used, equal to the CHP electrical efficiency multiplied by the fraction given by:</p> <p style="padding-left: 40px;">assumed CHP electricity CO₂ emission factor divided by grid electricity CO₂ emission factor</p> <p>The CHP heat efficiency and effective CHP electrical efficiency should then be entered in SAP.</p> <p>Note: for all alternatives, the CHP heat utilisation is taken into account in the heat efficiency of the CHP.</p>	Sept 2010 amended Sept 2013
6.07		Central heating pump	Always 2013 or later for a new dwelling.	October 2015
6.08		Low temperature heat emitters	The design flow temperature for condensing boilers and heat pumps should be assigned as unknown unless there is documentary evidence that the system has been designed and commissioned as a low temperature one.	October 2015

#	Limitations	Topic	Conventions	Issue date
6.09		Community CHP	SAP Appendix C, section C7 applies to any community CHP, not only biomass (e.g. CHP fired by municipal waste).	October 2015
6.10		Electric CPSU	An electric CPSU can use 10-hour or 18-hour tariff.	October 2015
6.11		Weather and load compensators	Compensators can be applied only if located in the database.	October 2015
6.12		Time and temperature zone control	<p>a. separate plumbing circuits, either with their own programmer, or separate channels in the same programmer, or</p> <p>b. programmable TRVs or communicating TRVs that are able to provide time and temperature zone control (conventional TRVs without a timing function provide only independent temperature control). In this case the device must be located in the database</p> <p>In both cases subject to the conditions in SAP section 9.4.14 (this applies to both SAP2012 and SAP 10).</p> <p>In the case of direct-acting electric systems, including underfloor heating, it can be achieved by providing separate temperature and time controls for different rooms.</p>	October 2015 amended Dec 2022
6.13		Underfloor heating in a wet room	In the case of community heating treat electric underfloor heating of small rooms (i.e. wet rooms) as a secondary room heater (panel, convector or radiant heater).	Aug 2017
6.14	England SAP 10	Hybrid heat pump	Only if from PCDB.	amended Dec 2022
	Wales and Scotland SAP2012		Refer to BRE technical note: https://www.bregroup.com/sap/bre-technical-notes/ .	Sept 2018 amended March 2021 amended Dec 2022

#	Limitations	Topic	Conventions	Issue date									
6.15	England SAP 10	District heat networks (HN) and	Data shall be obtained from the Builder.	Amended Dec 2022									
	Wales and Scotland SAP2012		<p>If GROSS annual efficiency of a boiler serving community heating (heat network) is available from 2009/2012 PCDB, use that efficiency. Note: it is the GROSS efficiency that is used in SAP.</p> <p>If GROSS annual efficiency not available from the PCDB:</p> <p>a) obtain annual GROSS efficiency from available sources, e.g. from the Manufacturer;</p> <p>b) If annual GROSS efficiency is not available from the available sources, but the 100% full-load efficiency and 30% part load efficiency test results are available, calculate the required annual GROSS Efficiency by following these steps:</p> <p>Step 1: convert both the 100% full-load and 30% part load efficiency from NET to GROSS by multiplying NET efficiency by the net-to-gross conversion factor for the appropriate fuel given in Table D2.1 in Appendix D of the SAP 2012 Specification:</p> $\eta_{\text{gross}} = f \times \eta_{\text{net}}$ <p style="text-align: center;">Table D2.1 : Efficiency conversion factors</p> <table border="1" style="margin-left: auto; margin-right: auto;"> <thead> <tr> <th>Fuel</th> <th>Net-to-gross conversion factor, f</th> </tr> </thead> <tbody> <tr> <td>Natural gas</td> <td>0.901</td> </tr> <tr> <td>LPG (propane or butane)</td> <td>0.921</td> </tr> <tr> <td>Oil (kerosene or gas oil)</td> <td>0.937</td> </tr> <tr> <td>Oil (biodiesel)</td> <td>0.937</td> </tr> </tbody> </table> <p>Step 2: for calculating annual GROSS efficiency refer to Equation 2 in Non-Domestic Services compliance guide; (use this link to access the guide: Non-Domestic Services Compliance Guide).</p> $\text{Boiler seasonal efficiency} = 0.81\eta_{30\%} + 0.19\eta_{100\%}$ <p>where:</p> <p>$\eta_{30\%}$ is the gross boiler efficiency measured at 30% load</p> <p>$\eta_{100\%}$ is the gross boiler efficiency measured at 100% load.</p> <p>c) if annual gross efficiency is not available from either PCDB, a) or b), use default efficiency from SAP 2012 Specification Table 4a.</p> <p>In the case of several boilers with available annual GROSS efficiency, either specify them separately or use the average boiler efficiency calculated according to Appendix C, section C2 in SAP 2012 Specification.</p>	Fuel	Net-to-gross conversion factor, f	Natural gas	0.901	LPG (propane or butane)	0.921	Oil (kerosene or gas oil)	0.937	Oil (biodiesel)	0.937
Fuel	Net-to-gross conversion factor, f												
Natural gas	0.901												
LPG (propane or butane)	0.921												
Oil (kerosene or gas oil)	0.937												
Oil (biodiesel)	0.937												

#	Limitations	Topic	Conventions	Issue date
DOMESTIC HOT WATER (DHW) HEATING				
7.01		Separate boiler or heat pump for DHW	<p>Sometimes there is a separate boiler or heat pump providing DHW only. If there is information about it in the PCDF, it can be entered into SAP software as follows:</p> <ul style="list-style-type: none"> - two main systems - main system 1 is that providing space heating - main system 2 is that DHW boiler - fraction of main heat from system 2 is zero - water heating from main system 2. 	Sept 2010 amended October 2015
7.02		More than one hot water system or multiple hot water cylinders	<p>Except in the case of heat pump systems, solid fuel room heaters with back boilers and where there is solar water heating, it is only possible to include one water heating system. In the event of there being more than one specified, the one selected should be that which is intended to heat most of the hot water, e.g. an immersion heater that is provided primarily as a backup should be disregarded.</p> <p>Where multiple hot water cylinders are used to provide space and water heating in a dwelling, the total volume and total cylinder heat loss should be entered into SAP calculations. For assessment of heat loss for building regulations compliance each cylinder should be assessed independently.”</p>	Sept 2010 amended March 2021
7.03		Independent programming of DHW heating	<p>Many heating system programmers have a single channel time control with a separate switch that can be set to 'H/W only', 'H/W and space heating', 'Space heating only' and similar combinations. Such a device does not provide independent programming of the hot water.</p> <p>In order to qualify as water separately timed it must be possible to program the space heating for two or more time periods a day and the hot water to be programmed for at least two different periods per day. This requires a time switch or programmer with more than one time control channel.</p>	Sept 2010
7.04		Primary pipework	For a new dwelling all primary pipework is regarded as accessible.	October 2015

#	Limitations	Topic	Conventions	Issue date
7.05		Instantaneous waste water heat recovery	<p>Valid only for hot water from a combi boiler or a mains pressure hot water system (thermal store or unvented cylinder) and for mixer showers having a thermostatic mixer valve.</p> <p>Two showers can be connected to the same WWHRS provided that the length of the drain pipe between shower and WWHRS is not excessive (generally less than 3 metres).</p> <p>SAP allows for two WWHR systems to be specified, but if there are two one of them must be System B.</p> <p>Instantaneous electric showers are included in the total number of showers in the dwelling but should NOT be included in the number of showers served by the WWHRS, because electric showers cannot have a WWHRS.</p> <p>For as-built assessments documentary evidence in the form of a completed WWHRS checklist is required.</p>	October 2015 amended Aug 2017
7.06		Cylinder heat loss: Watt to kWh/day conversion for DHW cylinders	<p>Use formula $(W/1000)*24=kWh/day$.</p> <p>For example 42W equals $(42/1000)*24=1.01 kWh/day$.</p>	amended Sept 2018
RENEWABLES				
8.02		Multiple wind turbines	A spreadsheet is available on BRE website, which accepts details of multiple turbine types and converts them into equivalent parameters for a single type that can be entered into software.	Sept 2012
8.03		PV pitch	Choose the nearest of 0, 30, 45, 60 or 90 to the actual pitch. If midway between two of these use the higher value.	October 2015

#	Limitations	Topic	Conventions	Issue date
8.04		PV connection	<p>Ascertain whether the PV is connected to the dwelling's electricity meter. If the position cannot be ascertained mark it as not connected.</p> <p>Note: The above affects only cost benefit. Carbon benefit is always counted.</p> <p>Where common areas in blocks of flats are assessed separately, the carbon benefit of PVs connected to landlord supply must not be counted twice.</p>	October 2015
SUMMER OVERHEATING				
9.01	Scotland and Wales SAP 2012	Cross ventilation	It is important that the guidelines set out in SAP Appendix P are adhered to in assessing whether or not there is cross ventilation and the extent of window opening. Issues to consider include the presence or otherwise of fire doors and the degree to which security concerns prevent windows being left open at night, e.g. ground floor flats.	Sept 2012 amended Dec 2022
9.02	Scotland and Wales SAP 2012	Windows opening	Assessor should be aware of security issues when specifying "windows half opened", or "windows fully opened" in the overheating assessment.	Sept 2018 amended Dec 2022
MISCELLANEOUS				
10.01		Transaction type	For a new dwelling the transaction type is always "New dwelling"	October 2015
10.02		Tenure	For a new dwelling the choice will often be "unknown", unless the tenure is known definitely.	October 2015

#	Limitations	Topic	Conventions	Issue date																								
10.03		BRE Technical Notes	<p>Technical Notes are produced by BRE to enable the recognition of certain technologies in SAP and/or RdSAP assessments. These are normally required due to complexities related to the technology's assessment that cannot easily be handled by SAP/RdSAP specifications.</p> <p>By their nature, Technical Notes are normally temporary (on the basis that future versions of SAP can incorporate recognition) and may therefore incorporate validity terms.</p> <p>Each Technical Note incorporates a technical justification section, followed by instructions for SAP/RdSAP assessors.</p> <p>The list of Technical Notes indicates whether a particular Technical Note is applicable to SAP or RdSAP. If a technology which might be a subject to a Technical Note is found in a dwelling, assessors must check the list of Technical Notes from the link given below to determine whether the technology is included and whether it is applicable to the type of assessment.</p> <p>If applicable, they must download a copy of the appropriate Technical Note from the link given in the list for each technical note and follow the instructions contained within it.</p> <p>The list of Technical Notes applicable to SAP and RdSAP, and the documents themselves, are published at the following BRE Website: https://www.bregroup.com/sap/bre-technical-notes/</p>	01 Sep 2019																								
10.04		Lodgement of incorrect EPC	If you lodged an EPC in error and then lodge a corrected EPC, inform your accreditation Scheme so that the erroneous one can be marked "not for issue".	March 2021																								
10.05	England SAP10	Default values for lighting calculation.	<p>When default details are used for lighting, use the following :</p> <table border="1"> <thead> <tr> <th>Lamp type</th> <th>Lm/W in SAP10.2</th> <th>Default W</th> <th>Default Lm</th> </tr> </thead> <tbody> <tr> <td>Linear fluorescent</td> <td>80.5</td> <td>8.3</td> <td>670</td> </tr> <tr> <td>LED/CFL</td> <td>66.9</td> <td>10</td> <td>670</td> </tr> <tr> <td>Halogen LV</td> <td>26.1</td> <td>25.7</td> <td>670</td> </tr> <tr> <td>Halogen</td> <td>15.7</td> <td>42.8</td> <td>670</td> </tr> <tr> <td>Incandescent</td> <td>11.2</td> <td>60</td> <td>670</td> </tr> </tbody> </table>	Lamp type	Lm/W in SAP10.2	Default W	Default Lm	Linear fluorescent	80.5	8.3	670	LED/CFL	66.9	10	670	Halogen LV	26.1	25.7	670	Halogen	15.7	42.8	670	Incandescent	11.2	60	670	Dec 2022
Lamp type	Lm/W in SAP10.2	Default W	Default Lm																									
Linear fluorescent	80.5	8.3	670																									
LED/CFL	66.9	10	670																									
Halogen LV	26.1	25.7	670																									
Halogen	15.7	42.8	670																									
Incandescent	11.2	60	670																									
10.06	England SAP10	Photographs are not available from the builder	Where photographs are not available from the builder, SAP Assessor can use default psi-values for the relevant junctions (unless psi-values can be evidenced by other means.	Dec 2022																								

#	Limitations	Topic	Conventions	Issue date
11.05		Validity of previous conventions	<p>England: <u>SAP 2009:</u> Conventions v5.0 was applicable from 01 October 2013. <u>SAP 2012:</u> assessments from April 2014 - Conventions v5.0. assessments from 01 December 2015 - Conventions v6.0. assessments from 01 July 2016 - Conventions v6.1. assessments from 31 August 2017 - Conventions v7.0 assessments from 01 September 2018 - Conventions v8.0 assessments from 01 September 2019 - Conventions v8.1 assessments from 01 March 2021 - Conventions v8.2 assessments from 01 December 2022 – Convention v 9.0</p> <p>Wales: <u>SAP 2009:</u> Conventions v5.0 was applicable from 01 October 2013. <u>SAP 2012:</u> assessments from July 2014 – Conventions v5.0. assessments from 01 December 2015 – Conventions v6.0. assessments from 01 July 2016 – Conventions v6.1. assessments from 31 August 2017 – Conventions v7.0 assessments from 01 September 2018 – Conventions v8.0 assessments from 01 September 2019 – Conventions v8.1 assessments from 01 March 2021 – Conventions v8.2 assessments from 01 December 2022 – Convention v 9.0</p> <p><u>Scotland:</u> <u>SAP 2009:</u> Conventions v5.0 was applicable from 01 October 2013. <u>SAP 2012:</u> assessments from 01 October 2015 – Conventions v5.0. assessments from 01 December 2015 – Conventions v6.0. assessments from 01 July 2016 – Conventions v6.1. assessments from 31 August 2017 – Conventions v7.0 assessments from 01 September 2018 – Conventions v8.0 assessments from 01 September 2019 – Conventions v8.1 assessments from 01 March 2021 – Conventions v8.2 assessments from 01 December 2022 – Convention v 9.0</p> <p>Northern Ireland: <u>SAP 2009:</u> Conventions v5.0 was applicable from 01 October 2013.</p>	Added Aug 2017 Sept 2018 Sept 2019 Jan 2021

Revision history

September 2010	First issue Conventions: 1.01 to 1.07, 2.01 to 2.02, 3.01, 4.01 to 4.03, 5.01 to 5.07, 6.01 to 6.06, 7.01 to 7.03, 8.01
March 2011	Second issue Re-numbered: 5.07 to 5.09 Amended: 1.02, 1.03, 1.04, 1.07, 5.01, 5.02, 5.03, 5.05, 5.06 1.06 deleted pending clarification Added: 5.07, 5.08, Appendix 1
September 2011	Third issue Amended 5.08 Added 1.08 to 1.11, 2.03 to 2.06, 3.02, 4.04, 5.10
September 2012	Fourth issue Amended 1.05, 1.08, 5.04, 5.07, 5.09 Added 8.02, 9.01
September 2013	Fifth issue Amended 6.06 Added Appendix 2
October 2015	Sixth issue Renumbered: 5.09 to 5.15 and Table 1 to Table 2 Added: 1.12, 1.13, 3.03, 3.04, 4.05, 5.11, 5.12, 5.13, 5.14, 6.07, 6.08, 6.09, 6.10, 6.11, 6.12, 7.04, 7.05, 8.03, 8.04, 10.01, 10.02, Table 1, A2.5, A2.7, A2.8 Amended: 1.02, 5.01, 5.03, 5.07, 5.08, 5.15, 6.04, 6.05, 7.01, A2.4, A2.13, A2.14 Deleted: 5.05, 8.01 (applied to SAP 2005 only)
October 2016 to 31 August 2017	Issue 7.0 Added: 1.02a, 1.03a, 1.04a, 2.07, 3.04a, 4.06, 4.07, 5.16, 6.13, 10.03 Revised: 1.02, 1.03, 1.04, 1.05, 1.08, 1.10, 2.01, 2.02, 2.03, 2.05, 3.01, 3.04, 4.03, 5.01, 5.02, 5.03, 5.04, 5.06, 5.07, 5.08, 5.12, 5.13, 5.15, 7.05, A2.4(a) Appendix 2 has been amended. Appendices renumbered and new appendices added: A2.4 "Convention for oriel windows", A2.5 "Conventions for curtain wall", A3 "U-values for rooms in roof", Appendix "Additional notes" deleted.
September 2018	Issue 8.0 Added: 5.18; 6.14; 9.02. Amended: 5.04; 5.23; 5.15; 5.17; 10.03; Amended Appendices: A2.9; A3; A4; A5.
September 2019	Issue 8.01 Added 10.03

March 2021	<p>Issue 8.2: Added:3.05; 5.19; 5.20; 6.15; 9.03; 10.04; Appendix 6. Amended: 4.01; 5.04; 5.18; 6.05; 6.14; 7.02; 10.03; A2.2; A2.3; A2.4; A2.6; A2.7; A2.13. Deleted: A2.8; A2.9; A2.10.</p>
December 2022	<p>Issue 9.0: Added: 1.14; 2.08; 4.01a; 5.00; A2.16 to A2.25; 10.05; 10.06; Appendix 7 Amended:1.01; 1.02; 1.02a; 1.03; 1.03a; 1.04, 1.04a; ;1.05; 1.10; 1.11; 1.13a; 1.13b; 1.13c; 2.01; 2.02; 2.05; 3.02; 3.04; 5.04; 5.06; 5.07; 5.08; 5.14; 5.15; 6.05; 6.12; 6.14; 6.15;- 9.01; 9.02; A2.4 Deleted: none</p>

Appendix 1 – Documentary evidence

Where particular data values are brought to a SAP calculation, evidence is needed to confirm them. This appendix sets out appropriate forms of documentary evidence.

#	Item	Conventions	Evidence
Documentary evidences from A2.1 to A2.15 applicable to users of SAP2012 and SAP10 methodologies. (A2.16 to A2.24 applicable only to users of SAP10 methodology)			
A2.1	U-values for external elements	5.01	U-value calculation data sheet including construction layers (materials, thickness and thermal properties) and U-value corrections.
A2.2	Window U-values and g-values	5.04	Certificate based on BFRC methodology, or the simulation report produced by the BFRC certified simulator. Statement from developer or equivalent person confirming the window properties as built, or that the windows meet minimum requirements of building regulations.
A2.3	Party wall U-values	5.03	<u>Sealing</u> Specification on plans of location of edge sealing, including edge sealing detail, e.g. drawing or named system, or written confirmation from builder that sealing has been done. <u>Filling and Sealing</u> Confirmation that MIMA Guidance http://mima.info/media/1222/mima-party-wall-bypass-guide_2018_lr.pdf has been adhered to, or written confirmation from builder that filling and sealing has been done.
A2.4	Air permeability as built England SAP 10	1.02	The test results for each dwelling accepted by Building Control, or a certificate from a person registered by an authorised air pressure testing scheme, for that dwelling.

#	Item	Conventions	Evidence
	Air permeability as built Wales SAP 2012		<p>For a dwelling that was tested the test results accepted by Building Control, or a certificate from a person registered by an authorised air pressure testing scheme, for that dwelling.</p> <p>For a dwelling that was not tested:</p> <ul style="list-style-type: none"> the test results accepted by Building Control, or a certificate from a person registered by an authorised air pressure testing scheme, for dwellings of the same dwelling type that were used to derive the input value on each development site; or if the dwelling is on a development site with no more than two dwellings: test results accepted by Building Control, or a certificate from a person registered by an authorised air pressure testing scheme, of a dwelling of the same dwelling type constructed by the same builder during the preceding 12 month period, or; where the test results accepted by Building Control or a certificate cannot be provided the value of 15m³/(h.m²) at 50Pa may be used in the SAP-calculation.
A2.4(a)	Scotland (SAP2012)	1.02 (a)	<p><u>For a dwelling that was tested:</u></p> <ul style="list-style-type: none"> a copy of the test certificate and written confirmation from the applicant/agent that the verifier has accepted that test certificate; <p><u>For a dwelling that was not tested:</u></p> <ul style="list-style-type: none"> written confirmation from the applicant/agent that the verifier has accepted the design infiltration rate recorded on the supplied drawings and specification for all untested dwellings. In some cases, action following sample testing may result in the applicant/agent and verifier agreeing a revised design infiltration rate. Note that this option includes dwellings where a 'default' infiltration rate of 15 m³/h.m² @ 50 Pa is declared and accepted. <p>An assessor should not be required to contact the verifier directly in this matter. Responsibility to provide complete and correct information on the subject dwelling rests with the party engaging the assessor's services.</p> <p>Criteria for the competence of a person undertaking tests are set out in paragraph 5.4 of the BSD document 'Sound and Airtightness Testing' available at: http://www.gov.scot/Topics/Built-Environment/Building/Building-standards/techbooks/ast2015.</p>

#	Item	Conventions	Evidence
A2.5	Overall dwelling specification		Confirmation in writing that the dwelling has been constructed and completed according to the specification provided to the assessor.
A2.6	Thermal bridging	5.06, 5.07, 5.08	Options include: <ul style="list-style-type: none"> - junction reference numbers and associated checklists for any ACDs or ECDs used; - Ψ-values and checklists by professional bodies; - manufacturers' Ψ-values and checklists where they have indicated that the calculations have been done by persons with suitable expertise and experience. - written confirmation that individual Ψ-values have been calculated by someone with suitable expertise and experience; - a copy of the detail or a reference to the detail number for a junction listed on the: https://www.bregroup.com/certifiedthermalproducts/podpage.jsp?id=3075
A2.7	Low temperature heating	6.08	Suitable evidence of low temperature design, e.g. Design, installation and commissioning certificate.
A2.8	Instantaneous waste water heat recovery	7.05	Requirement was deleted; covered under convention A2.5.
A2.9	Items from the Product Characteristics Database – heating and hot water systems, heating controllers, mechanical ventilation, FGHRs, WWHRs and hybrid heat pumps		Requirement was deleted; covered under convention A2.5.
A2.10	Manufacturer's declared efficiency values for room heaters		Requirement was deleted.
A2.11	Cooling systems		Manufacturer's declared value as specified in Table 10c of SAP 2012.
A2.12	Solar water heating, PVs	8.01	Data sheet or equivalent giving manufacturer name and <ul style="list-style-type: none"> - for solar water heating: area, efficiency and heat loss coefficient; - for PVs: the kWp rated power
A2.13	Community heating	6.05	If community heating (heat network) is not included in the PCDB then: <ul style="list-style-type: none"> - evidence for plant configuration and efficiency values; - evidence for choice of distribution loss factor.

#	Item	Conventions	Evidence
A2.14	Summer overheating	9.01	cross-ventilation/ fire doors, window opening and security
A2.15	Appendix Q		Consult Appendix Q documentation for the item concerned.
The following items are applicable only to SAP10 (England).			
A2.16	Lighting (power and efficacy per bulb type)	n/a	“Written evidence from the builder of the count of each type of bulbs, proof of fittings used stating power (W) and efficacy (Lm/w) for each light fitting type entered.”
A2.17	Showers (type & flow rates);	n/a	“Written evidence of manufacturer and model stating flow rate (l/min) of shower used is required where entering a flow rates.
A2.18	Battery storage (capacity);	n/a	“Written evidence of manufacturer and model of battery unit used, and usable capacity (kWh) is required. If this cannot be obtained, then the battery store cannot be entered.”
A2.19	PV Diverters	n/a	“Written evidence of manufacturer and model of diverter system installed is required. If this cannot be obtained, then the diverter cannot be entered.”
A2.20	Mech vent. duct level 1 and 2 options (SAP-10, Table 4h)	n/a	<p>“To claim for level 1 insulated ducts, written confirmation from the developer of the following is required;</p> <p>i.For supply (or extract, whichever is longer) duct lengths less than or equal to 2m, the duct system must be continuously insulated throughout to a minimum depth of 25mm with an insulant thermal conductivity of 0.04 W/m·K or less.</p> <p>ii.For supply (or extract, whichever is longer) duct lengths greater than 2m, the duct system must be continuously insulated throughout to a minimum depth of 50mm with an insulant thermal conductivity of 0.04 W/m·K or less.”</p> <p>Should this not be obtainable then level 2 must be used.”</p>

#	Item	Conventions	Evidence
A2.21	Community heating - distribution loss options	n/a	<ul style="list-style-type: none"> a. DLF in accordance with CIBSE Code of Practice - evidence from network designer and commissioning engineer needed; b. DLF from system in PCDB – Written confirmation that dwelling is connected to heat network
A2.22	Community Heating/Heat Network - date of CHP?	n/a	<ul style="list-style-type: none"> a. Pre 2015 CHP – “The heat networks claiming these factors will have to demonstrate to SAP assessors and Building Control that the gas CHP units were installed or commissioned before 2015 as an existing system” b. New CHP – “as above but for systems installed and commissioned on or after 15th June 2022 c. 2015+ CHP – “as above but for systems installed and commissioned between 01 January 2015 and 15th June 2022”
A2.23	Community Heating/Heat Network – CHP Export type (SAP 10.2 Table 12f)	n/a	<p>Written Confirmation from Network designer / commissioning engineer for the following:</p> <ul style="list-style-type: none"> a. Export only (all power sent to grid) b. Flexible operation (only runs when marginal generating plant on the grid is high carbon) c. Standard (any other type of system)
A2.24	Photographic evidences	n/a	<p>In accordance with Appendix B of Approved Document L1(2021) Assessors shall receive digital photographic evidence from the builder (which in addition may include a report) to show the thermal continuity and quality of insulation of the built construction, air tightness and building services.</p> <p>Assessors should satisfy themselves that the photographic evidence provided confirms the above as far as carrying out a SAP Assessment.</p>
A2.25	Evidence of “Export capable meter”	n/a	Developer’s statement is considered as an evidence

Appendix 2.1 Thermal bridges

Figure 2.1 : Location of thermal bridge types listed in SAP Table K1

It is expected that certification schemes will provide more detailed guidance for their assessors.

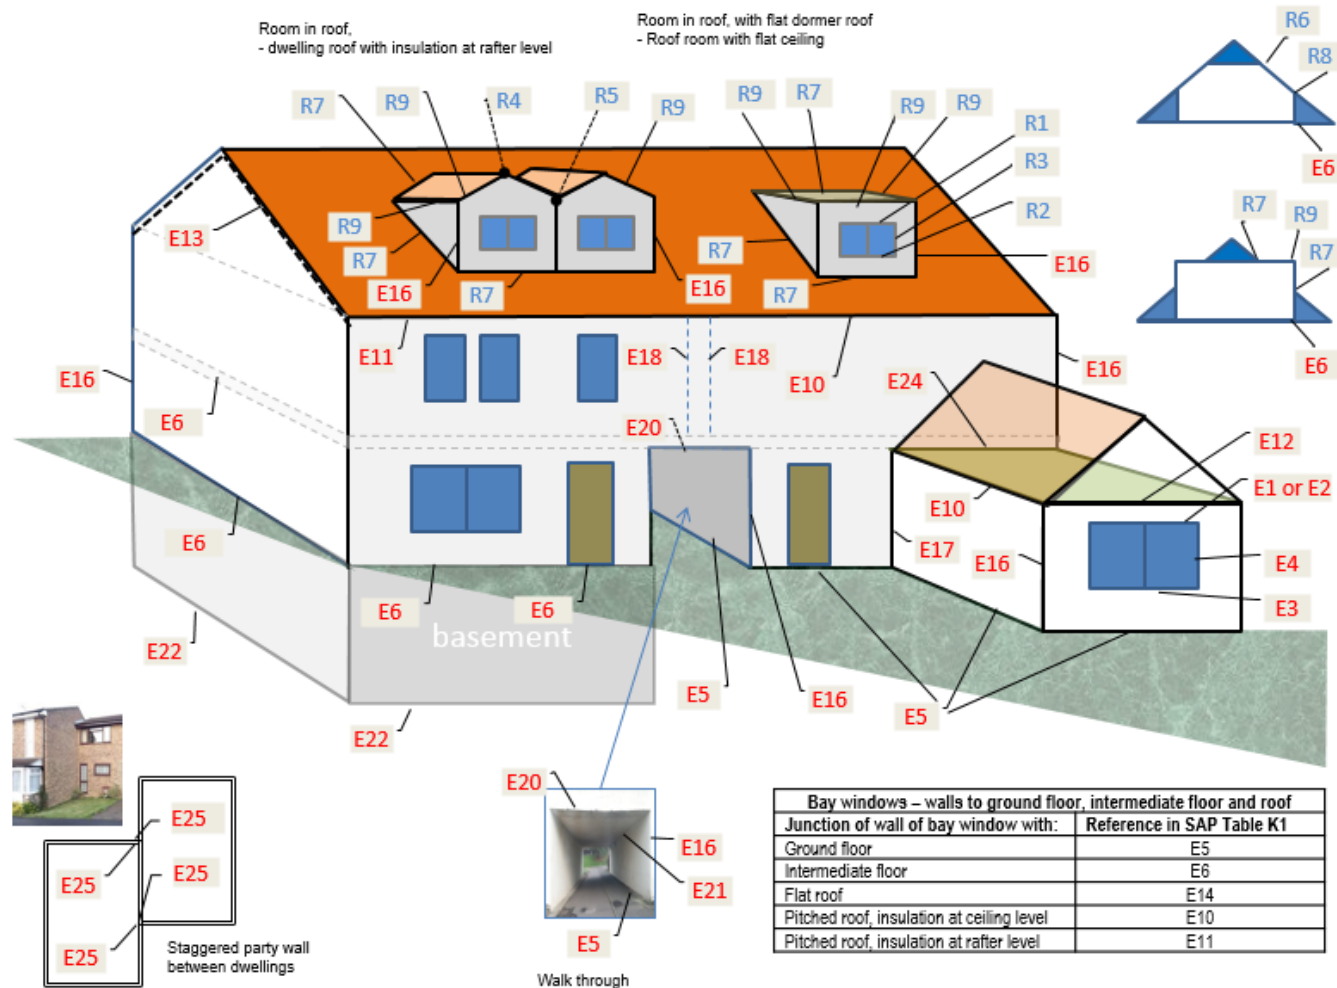


Figure 2.2.2 : Inverted corner and normal corner divided between two dwellings – use E18 for each junction for each dwelling.

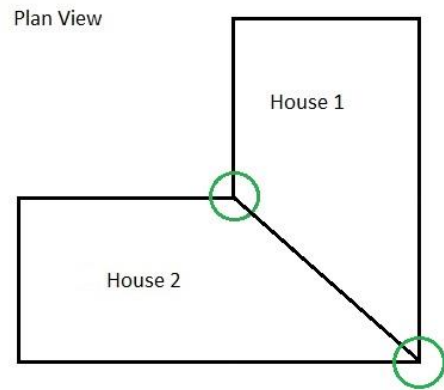
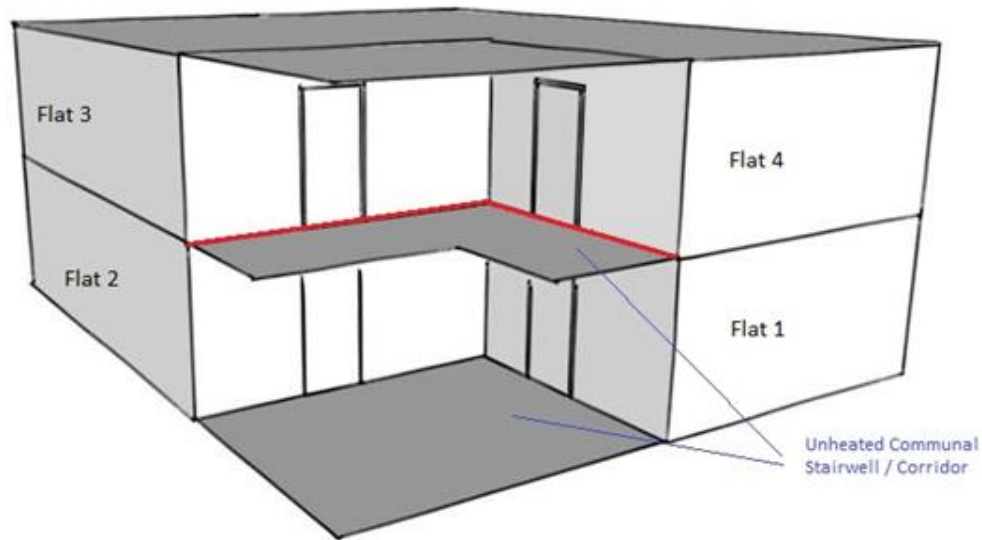






Figure 2.2.3 : Junction to unheated stairwell – treat as party floor (E6 or E7)







Appendix 2.3: Factors for sheltered thermal bridges (see convention 5.12)

Factors for integral single garages (single garage is a garage for one car)

Garage type		Elements between dwelling and garage	Factor for a single garage	
			Inside	Outside
Single fully integral		Side wall, end wall and floor	0.83	0.89
Single fully integral		One wall and floor	0.86	0.92
Single, partially integral displaced forward		Side wall, end wall and floor	0.85	0.91

Factors for integral double garages (double garage is a garage for two cars)

Garage type		Element between dwelling and garage	Factor for a double garage	
			Inside	Outside
Double garage fully integral		Side wall, end wall and floor	0.83	0.89
Double, half integral		Side wall, halves of the garage end wall and floor	0.91	0.94
Double, partially integral displaced forward		Part of the garage side wall, end wall and some floor	0.93	0.94

Factors for room in roof adjacent to unheated loft space

Area	Element between dwelling and unheated loft space	Factor
Room in roof built into a pitched roof insulated at ceiling level	insulated wall of room in roof	0.90
	or insulated ceiling of room below	0.90

Factors for stairwells and corridors

Elements between stairwell/corridor and dwelling	Heat loss from corridor through:	Factor
Stairwells:		
Facing wall exposed		0.74
Facing wall not exposed		0.71
Access corridors:		
Facing wall exposed, corridors above and below	facing wall, floor and ceiling	0.82
Facing wall exposed, corridor above or below	facing wall, floor or ceiling	0.85
Facing wall not exposed, corridor above and below	floor and ceiling	0.72
Facing wall not exposed, corridor above or below	floor or ceiling	0.78

Appendix 2.4 Thermal bridging - Convention for Oriel windows

Method 1: Oriel window modelled by detailed analysis

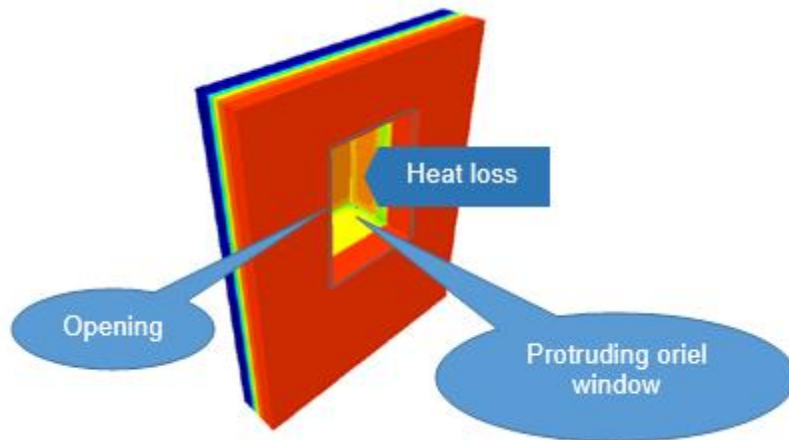
Heat loss from the opening from which an oriel window protrudes

$$Q_{\text{opening}} = Q_{\text{modelled}} - (U_{\text{wall}} \times A_{\text{wall}})$$

Effective U-value of the opening is:

$$U_{\text{effective}} = Q_{\text{opening}} / A_{\text{opening}}$$

$U_{\text{effective}}$ is applied to the projected area of opening

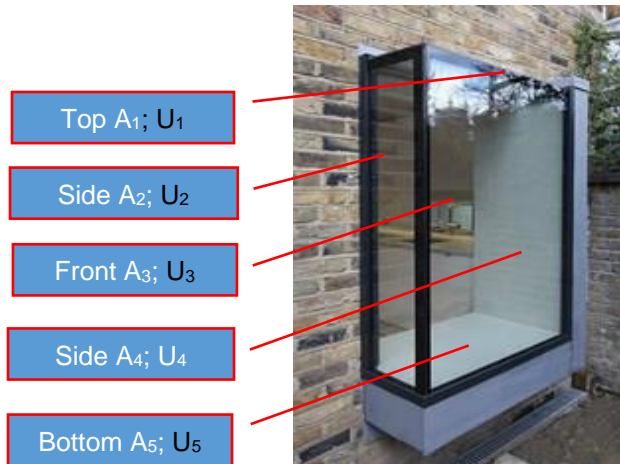


$U_{\text{effective}}$ takes into the account heat losses associated with thermal bridging, so Ψ -values associated with sills, jams and lintels are zero.

Method 2: Oriel window not modelled

An approximate conservative estimate of $U_{\text{effective}}$ is calculated as:

$$U_{\text{effective}} = \frac{\sum(A_n \times U_n) + f_{TB}}{A_{\text{openings}}}$$



A_{opening} is the area of opening in the wall (projected area)

$U_{\text{effective}}$ is the effective U-value that is applied to the projected area

f_{TB} factor that accounts for thermal bridges occurring in the oriel window;

$f_{TB} = 0.15$ is the default value recommended for the calculation; it covers all thermal bridges for a window and therefore no additional thermal bridging should be added for window sills, lintels or jambs.

Appendix 2.5 Thermal Bridging - Convention for curtain walls

See Convention 5.13 and 5.18 and Appendix 4.

SAP Assessor is responsible for the correct specification of curtain wall within the SAP Software.

Where thermal bridging has been included in the façade u-value, it is appropriate to input the measured length and apply a ψ -value of "0" in order to gain improvement on the notional value, but not for openings.

The façade U-value includes all effects of thermal bridging within the façade, and may also include the thermal bridging for other junctions such as corners calculated in line with EN ISO 12631. Therefore calculate the thermal bridging heat loss with:

- the lengths of window and door surrounds set to zero;
- the lengths of other junctions included in the calculated façade U-value entered as the actual length of junctions and psi-value set to zero;
- for all other junctions not included in the façade U-value enter their actual length and actual psi-value.

For example:



U-value of curtain wall would normally be calculated by a designer of the building and the results provided to SAP assessor.

U-value:

Apply the calculated overall curtain wall façade U-value, which incorporates all thermal bridges to the area of the curtain wall façade; refer to Appendix 4 diagram (a) for heights of individual flats in a building.

Thermal bridging calculation:

Since the notional calculation includes thermal bridging, it is important to specify appropriate lengths of thermal bridges at psi-value when doing thermal bridging calculation within SAP.

E6/E7 Intermediate floor within/between dwelling(s):

Include lengths of junctions and psi-values if these are not included in the calculation of the curtain wall façade;

E16/E17 Corner (Normal / Inverted):

Where each instance of this bridge has been included in the façade U-value calculation, specify the actual length of junctions and psi-value=0.

E18/E25 Party (& staggered) wall between dwellings:

Where each instance of this bridge has been included in the façade u-value calculation, specify the actual length of junctions and psi-value=0.

Junctions relating to window/door connections (lintel, jamb & sill):

Do not include lengths of junctions around window/door surrounds, they should be set to zero as per SAP section 3.6. (this is because notional U-value already includes allowance for thermal bridging for curtain wall).

Other junctions:

The junctions with ground floor E5 and roof (junction type depending on roof type) will be included using length of junction and appropriate psi-value.

Total solar energy transmittance, g-value:

In addition to the U-value, SAP calculation requires g-value for the glazing part of curtain wall.

The solar energy transmittance factor of glazing can be obtained from the glazing manufacturer. It is advisable to request g-value from the manufacturer along with the U-value of glazing as the source of data should be the same. Default g-values are not suitable for on-construction EPCs.

Frame factor:

SAP calculation also requires FF (frame factor). Use FF=1 in the case of curtain walls.

Appendix 2.6 Web links for thermal bridge details

Accredited Construction Details (ACD):

England & Wales: https://www.planningportal.co.uk/info/200135/approved_documents/74/part_1_-_conservation_of_fuel_and_power/6

Scotland: <http://www.gov.scot/publications/building-standards-list-of-guidance/pages/key-supporting-technical-guidance/>

The Scotland ones can be used in England & Wales if the actual construction corresponds.

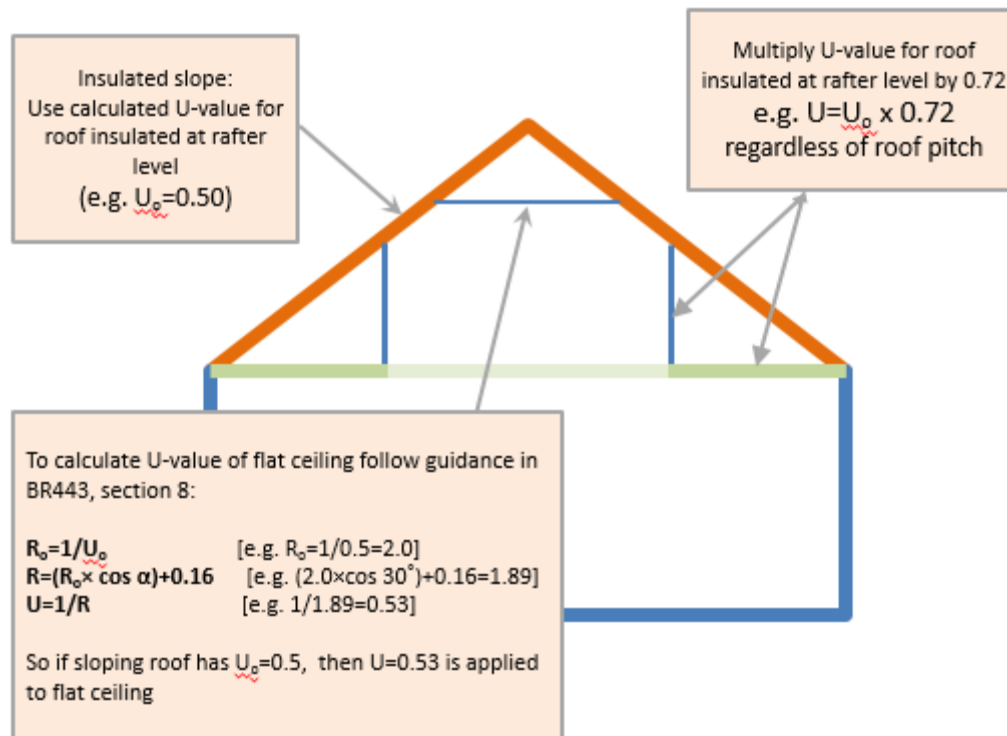
Enhanced Construction details (ECD):

http://www.energysavingtrust.org.uk/resources/reports?keyword=Enhanced+construction+details&sort_by=created&=Apply+filters

Appendix 3 Converted U-values for room in roof

Establishing the U-value of other elements of room in roof if the only available U-value is the calculated U-value of the insulated sloping roof.

The diagram shows the situation where only the sloping roof is insulated. The formulas are used to convert the U-value of insulated sloping roof into U-values applicable to the horizontal and vertical components of RR.
(see convention 2.07)

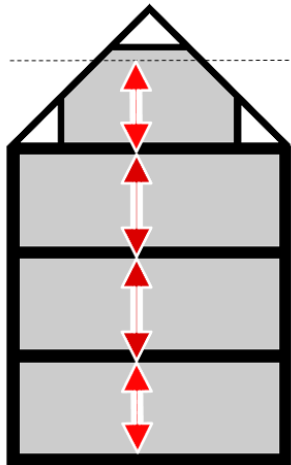


Appendix 4. Dwelling dimensions

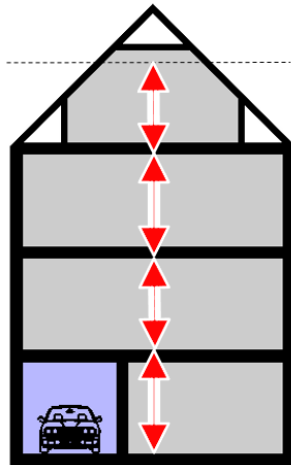
The diagrams below show how to measure height of storeys.

(4.1) Multi-storey dwellings (and for buildings with curtain walls)

(a) Dwelling without a garage

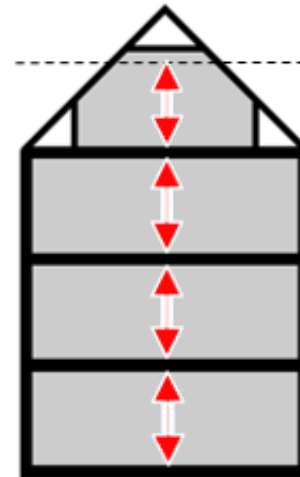


(b) Dwelling with a garage

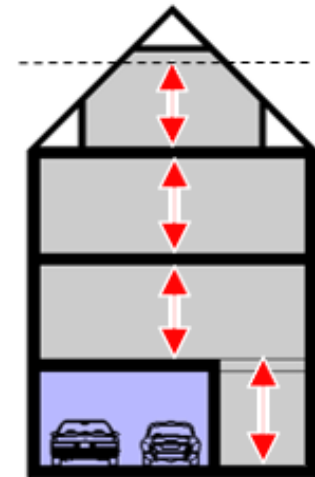


(4.2) Blocks of flats (NOT for buildings with curtain walls)

Block of flats without a garage



Block of flats with a garage



Appendix 5. Thermal mass parameters

The values are for the whole dwelling (applicable to SAP2012 only)

The following table provides the thermal mass for some illustrative constructions.

Note: it is recommended to use calculated internal heat capacity (kappa-values) of all building elements and calculate the actual Thermal Mass Parameter for the whole building; this table should be used only when calculated kappa-values of building elements is not available.

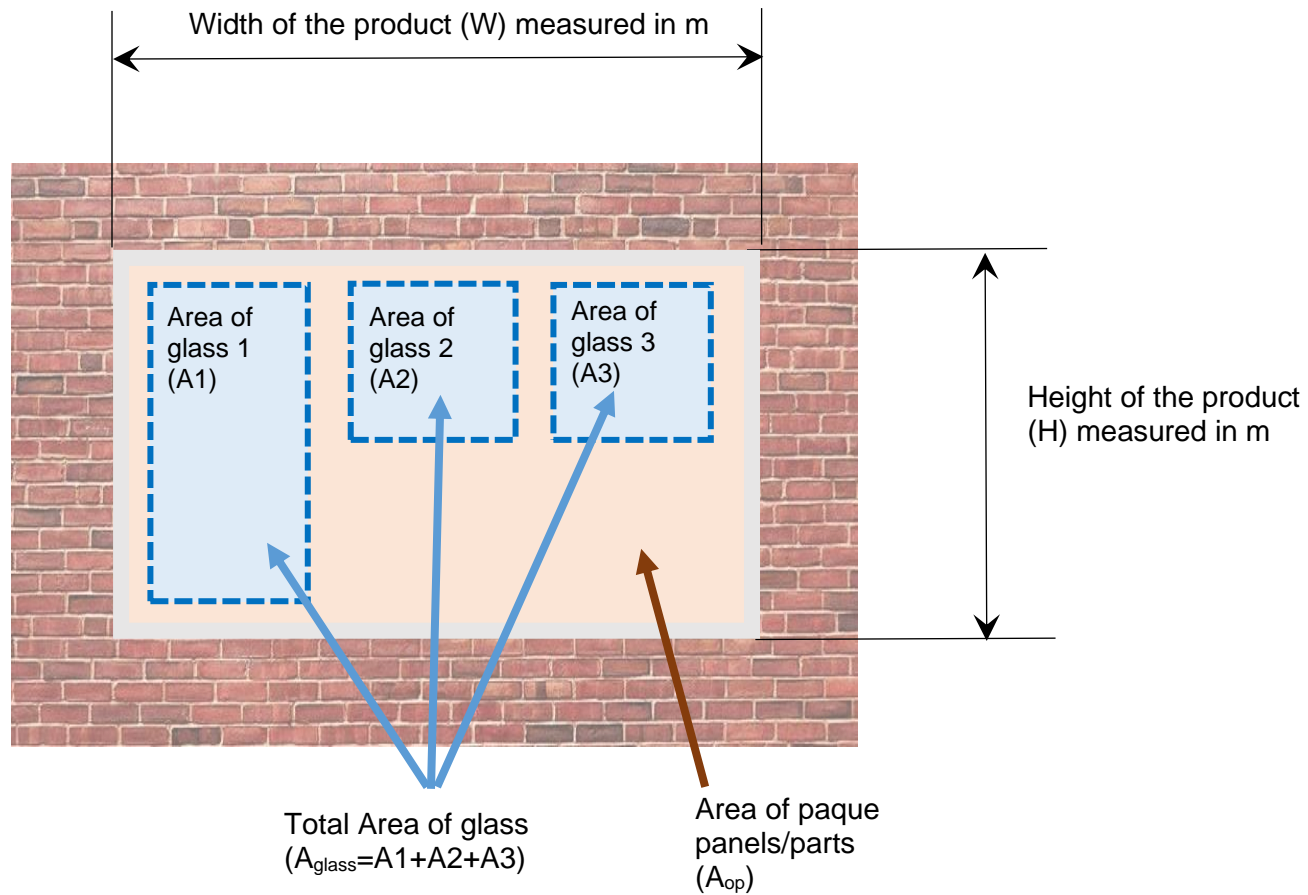
. Thermal mass of elements (This is an internal heat capacity of a building element)				Illustrative construction	Indicative Thermal Mass of the whole building
Ground floor	External walls	Party wall*	Internal partitions		
Low	Low	Low	Low	Suspended timber floor, carpeted Timber frame external wall* Timber frame party wall** Partitions: plasterboard on timber frame	Low
Medium	Low	Low	Low	Suspended concrete floor, carpeted Timber frame external wall* Timber frame party wall** Partitions: plasterboard on timber frame	Low
Medium	Medium	Low	Low	Suspended concrete floor, carpeted Masonry cavity wall* – AAC block, filled cavity Timber frame party wall** Partitions: plasterboard on timber frame	Low
Medium	Medium	Medium	Low	Suspended concrete floor, carpeted Masonry cavity wall* – AAC block, filled cavity AAC party wall** Partitions: plasterboard on timber frame.	Medium
Medium	Medium	Medium	Medium	Suspended concrete floor, carpeted Masonry cavity wall* – AAC block, filled cavity AAC party wall** Partitions: medium block, plasterboard on dabs	Medium

. Thermal mass of elements (This is an internal heat capacity of a building element)				Illustrative construction	Indicative Thermal Mass of the whole building
Ground floor	External walls	Party wall*	Internal partitions		
High	Medium	Medium	Medium	Slab on ground, carpeted Masonry cavity wall* – AAC block, filled cavity AAC party wall** Partitions: dense block, plasterboard on dabs	Medium
High	High	Medium	Medium	Slab on ground, carpeted Masonry cavity wall* – dense block, filled cavity AAC party wall** Partitions: medium block, plasterboard on dabs	Medium
High	High	High	Medium	Slab on ground, carpeted Masonry cavity wall* – dense block, filled cavity Dense block party wall** Partitions: medium block, plasterboard on dabs	High
High	High	High	High	Slab on ground, carpeted Masonry cavity wall* – dense block, filled cavity Dense block party wall** Partitions: dense block, dense plaster	High

* If external walls are internally insulated (e.g. insulating plasterboard on dabs), treat external walls as low thermal capacity walls.

** If party wall is not present, disregard the "Party wall" column

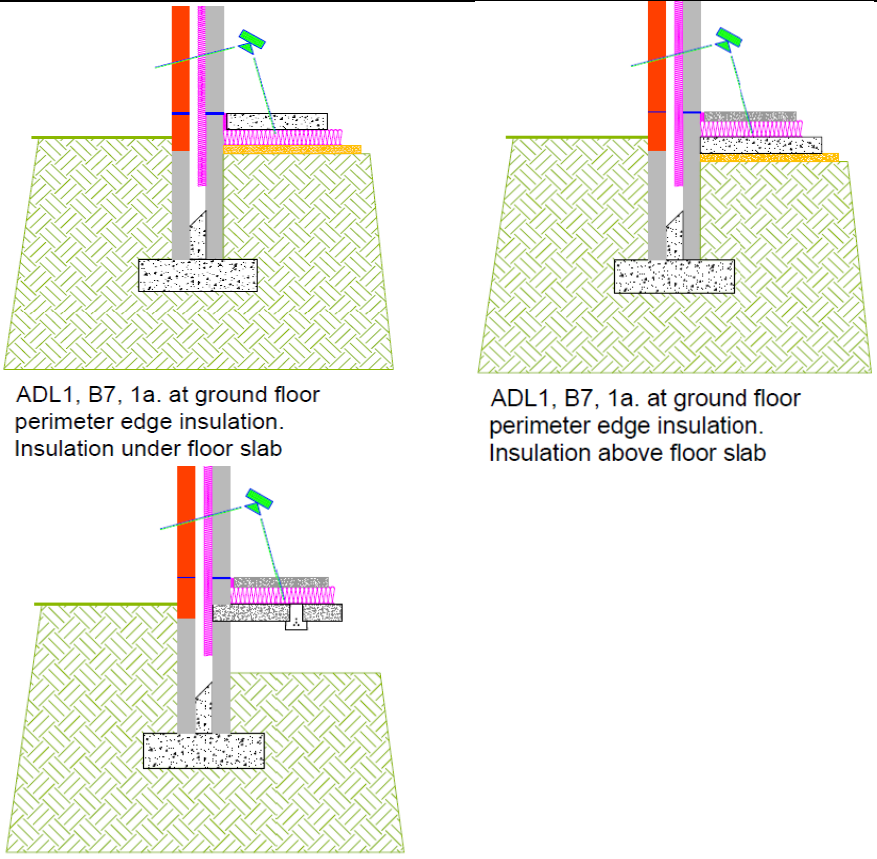
Appendix 6 Mixed glazing and opaque units

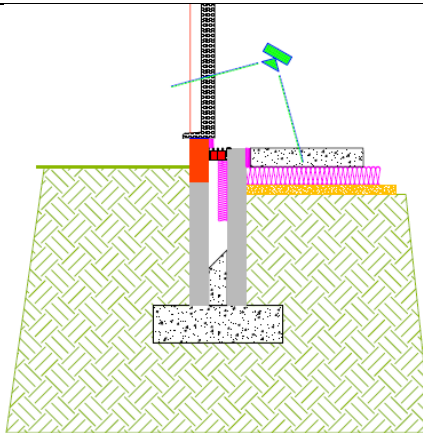


- A. The area of the product, P, (equal to the opening in the wall): $P = W \times H$, in m^2
- B. The total area of translucent sections (i.e. area of glass) in the product : $A_{\text{glass}}=A1+A2+A3$, in m^2
- C. The area of opaque part is calculated by subtracting area of glass from the total area of the product; $A_{\text{op}} = P - A_{\text{glass}}$, in m^2

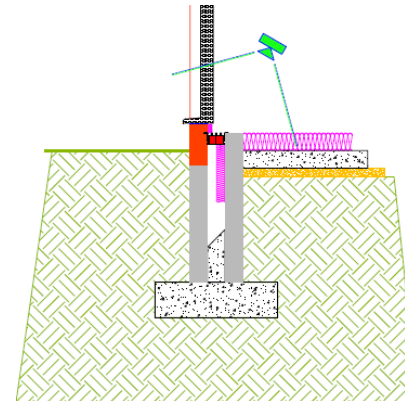
APPENDIX 7 Examples of details submitted as photographic evidences

ADL §B7 (1) **Foundations/substructure and ground floor**, to show thermal continuity and quality of insulation in the following places.

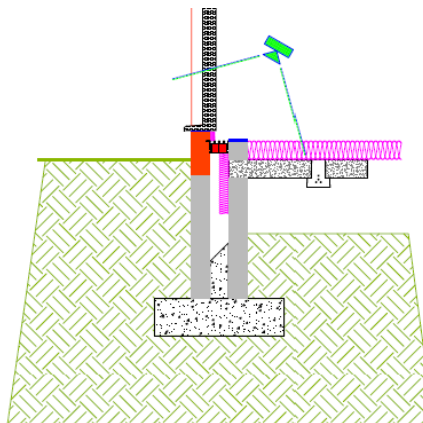
Ref	Detail	No of photos*	What should be shown on the photo - examples
1a	At ground floor perimeter edge insulation (Presence of insulation at the edge)	1 for detached 2 for other types	 <p>ADL1, B7, 1a. at ground floor perimeter edge insulation. Insulation under floor slab</p> <p>ADL1, B7, 1a. at ground floor perimeter edge insulation. Insulation above floor slab</p> <p>ADL1, B7, 1a. at ground floor perimeter edge insulation. Insulation above suspended floor slab or B&B</p>
1b	At external door threshold.	1 photo	



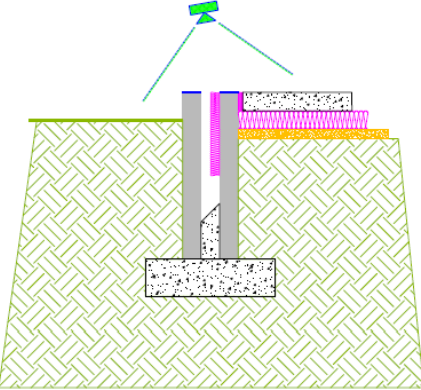
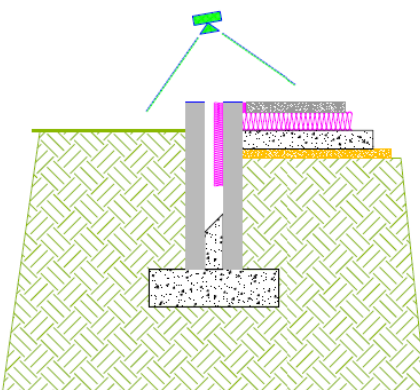
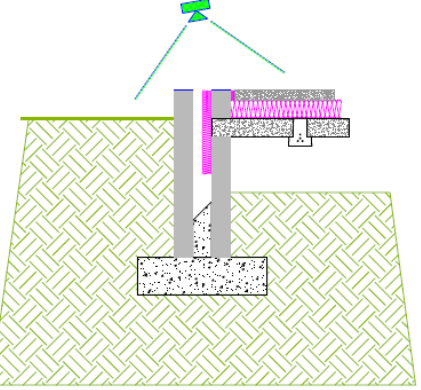
ADL1, B7, 1b. at external door threshold.
Insulation under floor slab



ADL1, B7, 1b. at external door threshold.
Insulation above floor slab



ADL1, B7, 1b. at external door threshold.
Insulation above suspended floor slab or B&B

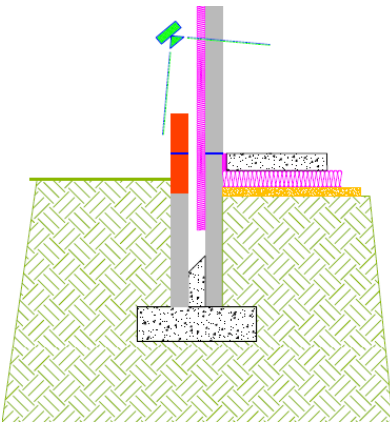
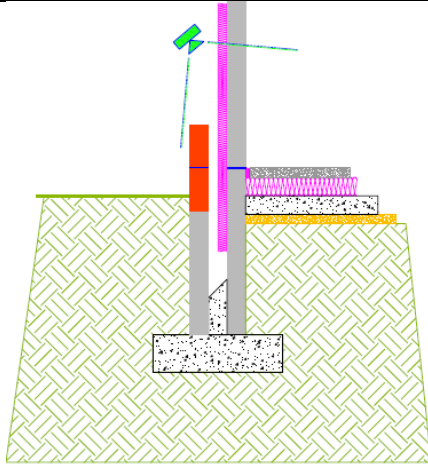
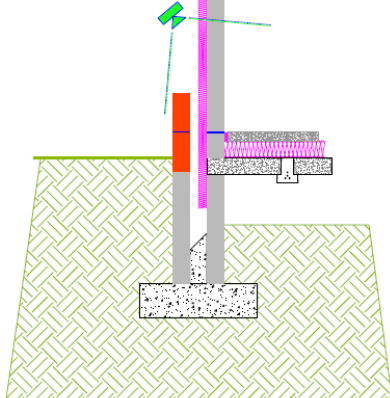
1c	Below damp-proof course on external walls.	1 for detached 2 for other types	<div style="display: flex; justify-content: space-around;"> <div style="text-align: center;">  <p>ADL1, B7, 1c. below damp proof course on external walls. Insulation under floor slab</p> </div> <div style="text-align: center;">  <p>ADL1, B7, 1c. below damp proof course on external walls. Insulation above floor slab</p> </div> </div> <div style="text-align: center; margin-top: 20px;">  <p>ADL1, B7, 1c. below damp proof course on external walls. Insulation above suspended floor slab or B&B</p> </div>
----	--	-------------------------------------	---

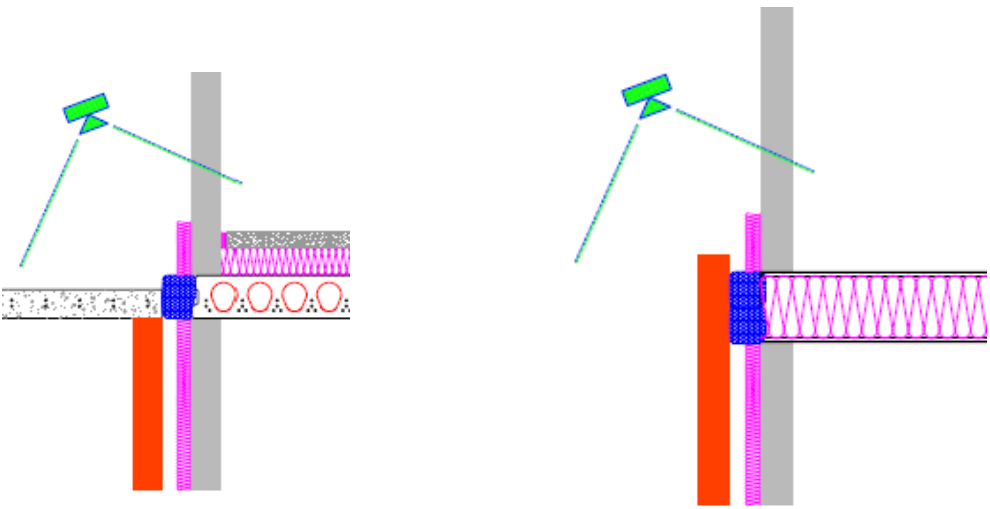
* an additional close-up photo can be added only when necessary

Note: The quality of photos should be subject to ADL §B7.

Note: Regarding "at external door threshold"; it could be a combination of E3 (sill) and E5 (ground floor) so what needs to be photographed, as if the door sits on top of the DPC (Damp Proof Course) then there is no E3.

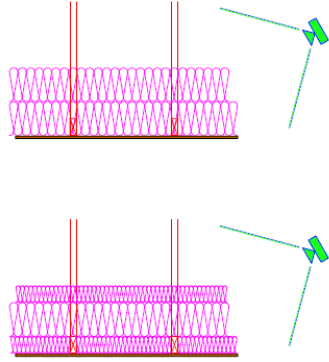
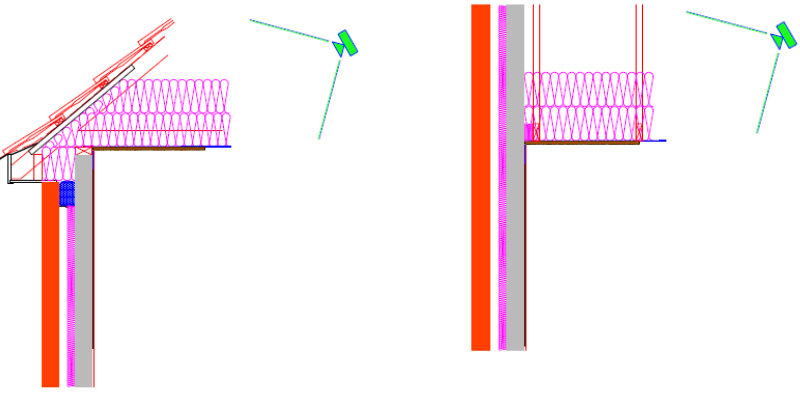
ADL §B7 (2) **External walls: for each main wall type**, to show thermal continuity and quality of insulation for the following.

Ref	Detail	No of photos*	What should be shown on the photo
2a	Ground floor to wall junction.	1 for detached 2 for other types	<div style="display: flex; justify-content: space-around;"> <div style="text-align: center;">  <p data-bbox="891 742 1265 821">ADL1, B7, 2a. Ground floor to wall junction. Insulation under floor slab</p> </div> <div style="text-align: center;">  <p data-bbox="1370 730 1774 821">ADL1, B7, 2a. Ground floor to wall junction. Insulation above floor slab</p> </div> </div> <div style="text-align: center; margin-top: 20px;">  <p data-bbox="891 1252 1265 1358">ADL1, B7, 2a. Ground floor to wall junction. Insulation above suspended floor slab or B&B</p> </div>

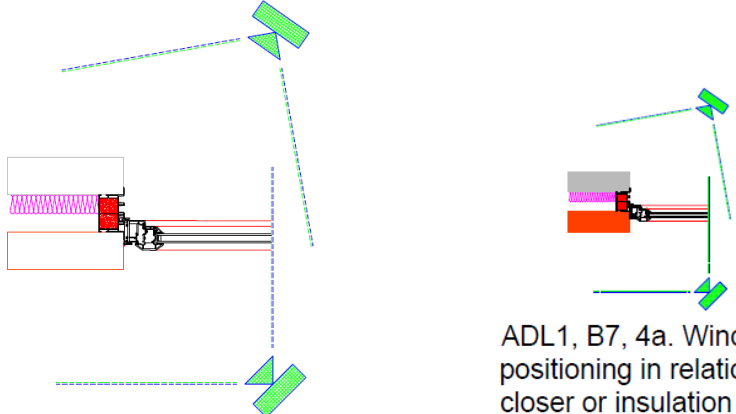

2b	Structural penetrating elements.	1 photo	 <p data-bbox="884 678 1288 774">ADL1, B7, 2b. Structural penetrating elements. pre-cast concrete floor beam</p> <p data-bbox="1444 646 1870 774">ADL1, B7, 2b. Structural penetrating elements. steel beam, webs insulated for first 1m</p>
----	----------------------------------	---------	--

* an additional close-up photo can be added only when necessary
 Note: The quality of photos should be subject to ADL §B7.

ADL §B7 (3) **Roof:** for each main roof type, to show thermal continuity and quality of insulation at the following.

Ref	Detail	No of photos*	What should be shown on the photo
3a	Joist/rafter level	1 for detached 2 for other types	 <p data-bbox="891 651 1218 730">ADL1, B7, 3a. Joist/rafter level. Insulation between and across and deeper between trusses</p>
3b	Eaves and gable edges	1 photo	 <p data-bbox="898 1177 1227 1230">ADL1, B7, 3b. Eaves and gable edges.</p> <p data-bbox="1330 1185 1659 1238">ADL1, B7, 3b. Eaves and gable edges.</p>
<p>* an additional close-up photo can be added only when necessary Note: The quality of photos should be subject to ADL §B7.</p>			

ADL §B7 (4) **Openings:** for each opening type (one image per wall or roof type is sufficient), to show thermal continuity and quality of insulation with photographs of the following.

Ref	Detail	No of photos*	What should be shown on the photo
4a	Window positioning in relation to cavity closer or insulation line	1 for detached 2 for other types	 <p data-bbox="1406 587 1780 678">ADL1, B7, 4a. Window positioning in relation to cavity closer or insulation line</p>
4b	External Dorset positioning in relation to cavity closer or insulation line	1 photo	 <p data-bbox="900 1013 1294 1109">ADL1, B7, 4b. External doorset positioning in relation to cavity closer or insulation line</p>
<p data-bbox="206 1161 990 1189">* an additional close-up photo can be added only when necessary</p> <p data-bbox="206 1197 891 1224">Note: The quality of photos should be subject to ADL §B7.</p>			

ADL §B7 (5) **Airtightness:** additional photographs for all details 1–4 to show airtightness details (only if not included or visible in continuity of insulation image)

Ref	Detail	No of photos*	What should be shown on the photo
5a	Joist/rafter level	1 photo	To be defined by the Builder

* an additional close up photo can be added only when necessary

Note: The quality of photos should be subject to ADL §B7.

ADL §B7 (6) **Building services:** for all plant associated with space heating, hot water, ventilation and low or zero carbon technology equipment within or on the building, show the following.

Ref	Detail	No of photos*	What should be shown on the photo
6a	Boiler (main heating)	1 photo 2 if two systems	Boiler label, make, model and serial number
6b	Primary pipework	1 photo 2 if two systems	Photo to show that primary pipework is insulated.
6c	Mechanical ventilation ductwork	1 photo	Presence of insulation outside the thermal envelope; Diagram to be added

* an additional close-up photo can be added only when necessary

Note: The quality of photos should be subject to ADL §B7.

*When photographs are received, with the plot number and detail reference according to the numbers used in ADL §B7 and §B8, SAP Assessor uses them in **addition** to the documentary evidences required by the SAP Conventions.*

*The references of photos (e.g.P1/3b) are **not** for including into BREL Section 2b.*

Photos with the plot number and detail reference according to the numbers used in ADL §B7 and §B8, are stored by SAP Assessor together with other documentary evidenced required for SAP Assessment.